


A. Site Energy Production Summary

	Energy Production (kWh)			
	Site		By Turbine	
	P50 (Expected Production)	Actual Production	W1	W2
Jan-23	875,000	703,088	359,790	343,298
Feb-23	917,000	890,580	449,499	441,081
Mar-23	802,000	918,289	462,488	455,801
Apr-23	951,000	686,249	342,823	343,426
May-23	601,000	541,021	268,754	272,267
Jun-23	425,000	413,801	210,347	203,454
Jul-23	390,000	267,109	135,436	131,673
Aug-23	399,000	366,119	185,571	180,548
Sep-23	337,000	243,413	123,119	120,294
Oct-23	637,000	624,439	317,183	307,256
Nov-23	834,000	857,725	431,836	425,889
Dec-23	1,015,000	658,931	330,556	328,375
Jan-24	875,000	630,572	316,894	313,678
Production 2024 (ytd) (kWh)	875,000	630,572	316,894	313,678
Total Production (LTM) (kWh)	8,183,000	7,098,248	3,574,506	3,523,742
Capacity Factor (LTM)	27.01%			

B. Site Energy Production Graph

January-2024

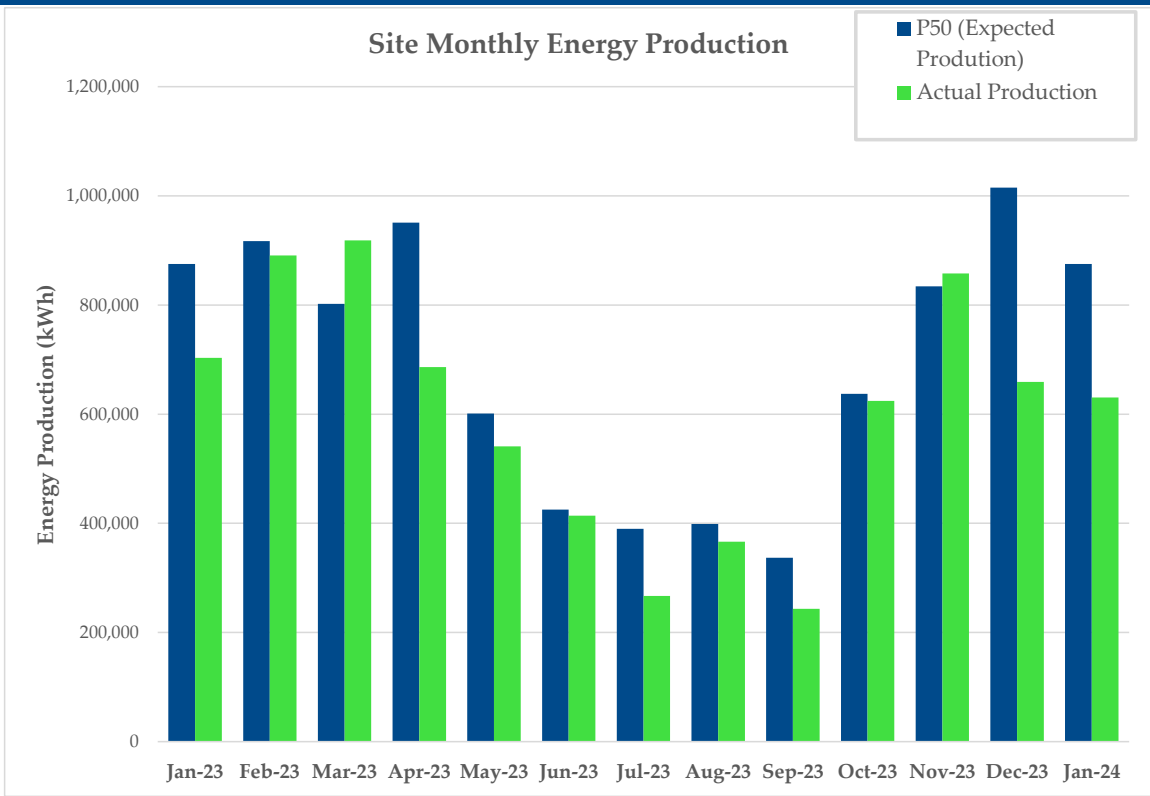

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
May-2024	Goldwind 8.5 Year Maintenance	~8	W1
May-2024	Goldwind 8.5 Year Maintenance	~8	W2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
1/4/2024	Weather Shutdown	Unplanned	6.64	W1
1/22/2024-1/31/2024	Fleet Inspection Shutdown	Unplanned	227.11	W1
1/22/2024-1/31/2024	Fleet Inspection Shutdown	Unplanned	226.97	W2

F. Turbine Availability & Downtime*

Availability	This Month	Year To Date
W1	100.00%	100.00%
W2	99.97%	99.97%
Avg	99.99%	99.99%

Downtime (hr)	This Month	Year To Date
W1	236.07	236.07
W2	233.45	233.45
Total	469.52	469.52

G. Billed Data

Meter Reading (Date/Time)	1/29/2024 12:00 AM
Meter To Date Produced	61,466,530 kWh
Meter To Date Consumed	121,125 kWh
Last Reading Produced	60,792,199 kWh
Last Reading Consumed	118,801 kWh
Billed kWh	672,007 kWh
Next Meter Reading	2/29/2024 12:00 AM

H. Report Notes and Comments

*Downtime beginning January 22, 2024 is classified under the 'Other' category due to an ongoing root cause investigation within the fleet; this classification may be subject to reallocation at a later date.