


A. Site Energy Production Summary\*

	Energy Production (kWh)					
	Site		By Turbine			
	P50 (Expected Production)	Actual Production	WTG 1	WTG 2	WTG 3	
Apr-24	1,335,000	696,296	320,266	107,262	268,768	3
May-24	1,106,000	725,087	270,871	206,159	248,057	
Jun-24	836,000	0				
Jul-24	694,000	0				
Aug-24	619,000	0				
Sep-24	839,000	0				
Oct-24	1,294,000	0				
Nov-24	1,428,000	0				
Dec-24	1,459,000	0				
Jan-25	1,589,000	0				
Feb-25	1,306,000	0				
Mar-25	1,331,000	0				
Apr-25	1,335,000	0				
Production 2024 (ytd) (kWh)	2,441,000	1,421,383	591,137	313,421	516,825	
Total Production (LTM) (kWh)	-	-	-	-	-	
Capacity Factor (LTM) <sup>1</sup>	-		*Value calculated over the last 12 months			

B. Site Energy Production Graph

May-2024

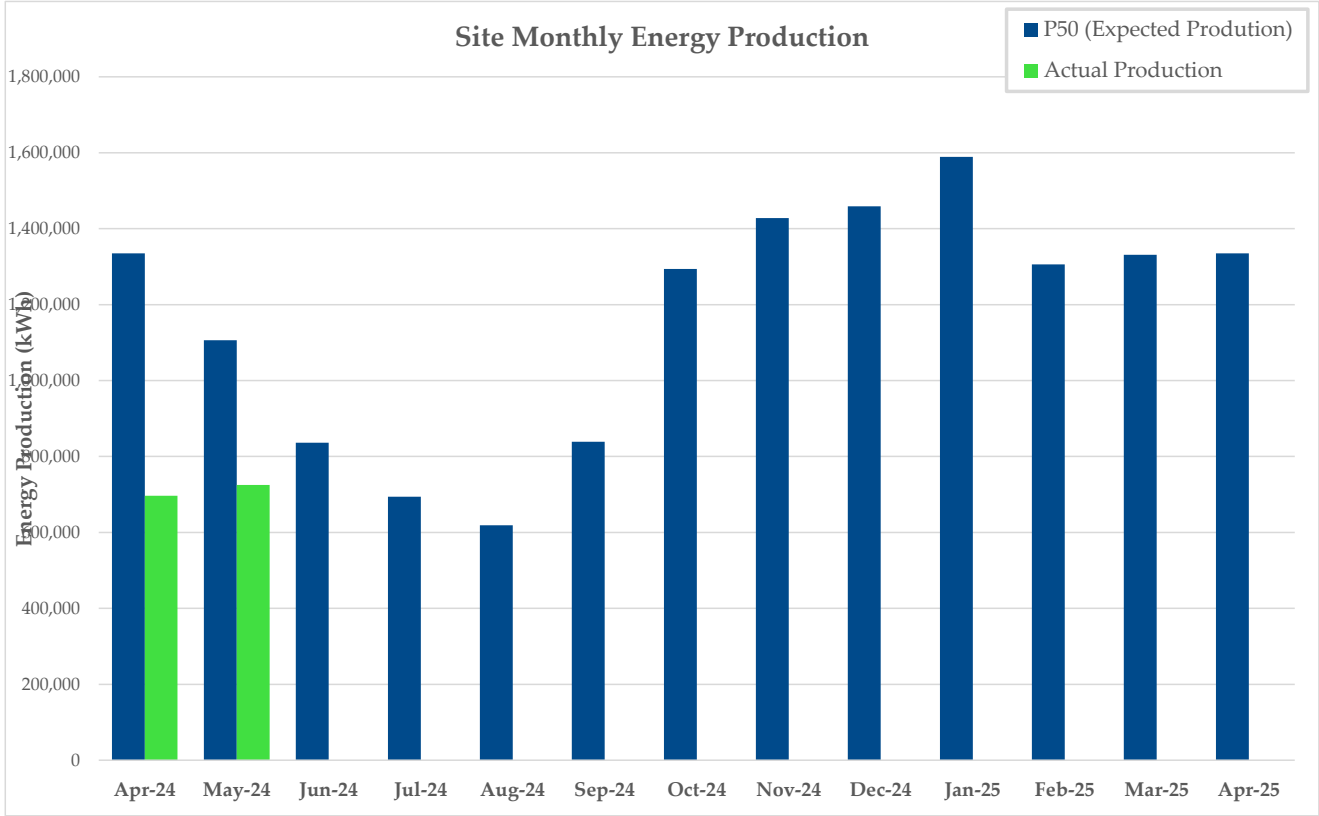

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
Jun-24	500hour Maintenance	~20	WTG 1
Jun-24	500hour Maintenance	~20	WTG 2
Jun-24	500hour Maintenance	~20	WTG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
5/24/2024	Customer Maintenance	Unplanned	6.10	WTG 1

F. Turbine Downtime <sup>2</sup>

Downtime (hr)	This Month	Year To Date
WTG 1	6.10	6.10
WTG 2		62.43
WTG 3	2.38	10.17
Total	8.48	78.70

G. Billed Data

Meter Reading (Date/Time)	6/1/2024 12:00 AM
Meter To Date Produced	1,407,575
Meter To Date Consumed	7,070
Last Reading Produced	694,469
Last Reading Consumed	3,633
Billed kWh	709,669 kWh
Next Meter Reading	7/1/2024 12:00 AM

H. Report Notes and Comments

<sup>1</sup> Capacity factor to be included once full year of data is available.

<sup>2</sup> Turbine Availability/Downtime Pending.

<sup>3</sup> Turbines were actively generating starting these days:

WTG 1 - April 10

WTG 2 - April 18

WTG 3 - April 9

Energy generation was billed to the customer starting April 18, 2024