


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	L1	L2	L3
Jun-23	751,000	649,782	224,391	226,181	199,210
Jul-23	609,000	360,370	124,670	123,847	111,853
Aug-23	534,000	594,879	204,225	207,630	183,024
Sep-23	736,000	400,037	139,966	142,124	117,947
Oct-23	1,131,000	1,024,588	350,783	351,133	322,672
Nov-23	1,281,000	1,328,497	453,156	447,161	428,180
Dec-23	1,263,000	1,020,636	343,379	344,554	332,703
Jan-24	1,433,000	837,413	281,008	279,606	276,799
Feb-24	1,213,000	0	0	0	0
Mar-24	1,339,000	0	0	0	0
Apr-24	1,327,000	57	0	0	57
May-24	1,052,000	0	0	0	0
Jun-24	751,000	36,320	0	36,320	0
Production 2024 (ytd) (kWh)	7,115,000	873,790	281,008	315,926	276,856
Total Production (LTM) (kWh)	12,669,000	5,602,797	1,897,187	1,932,375	1,773,235
Capacity Factor (LTM)	14.17%				

B. Site Energy Production Graph

June-2024

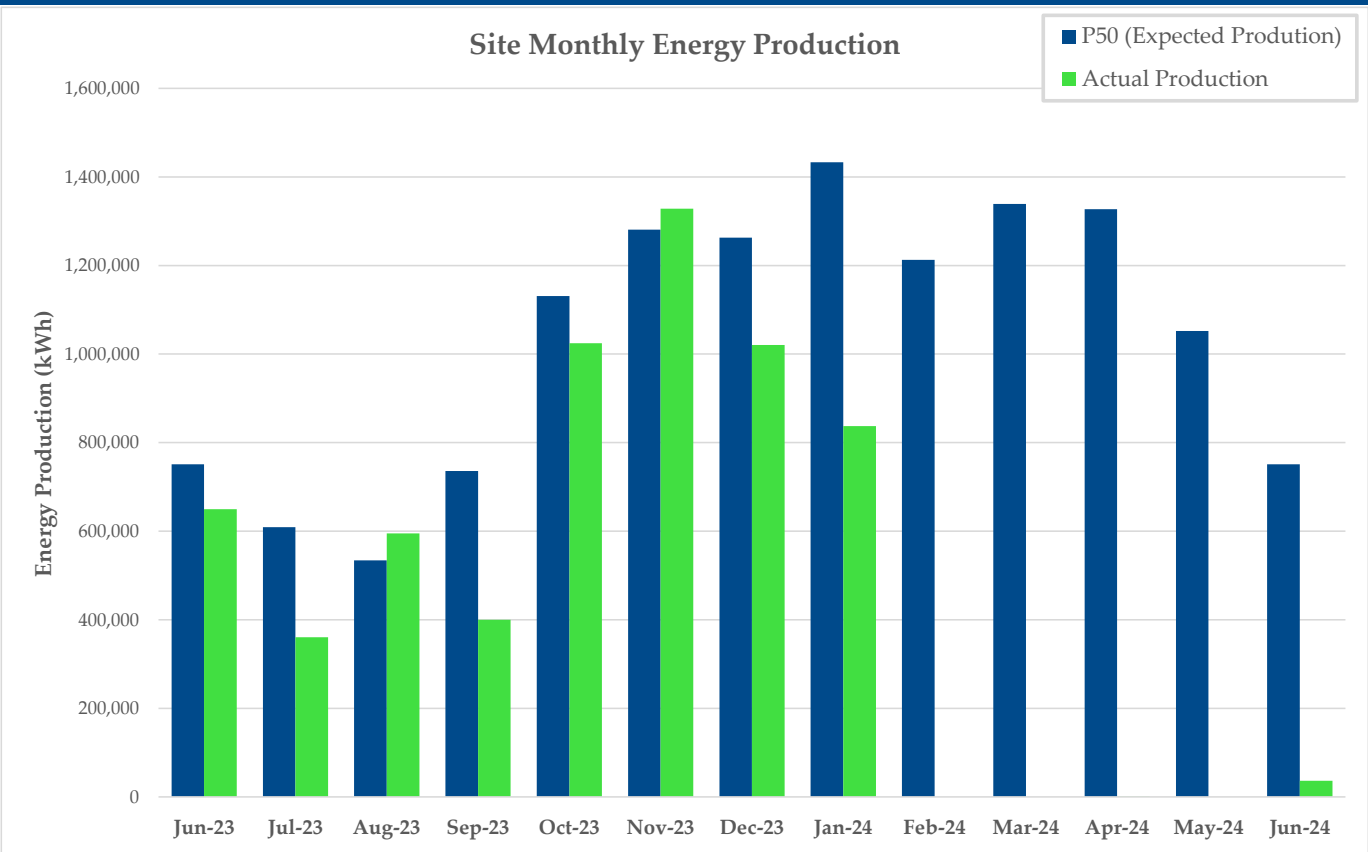

Monthly Report

June-2024

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2024	4 Year Preventive Maintenance	~15	L1
September-2024	4 Year Preventive Maintenance	~15	L2
September-2024	4 Year Preventive Maintenance	~15	L3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
6/1/2024-6/30/2024	Fleet Retrofit Pending	Unplanned	720	L1, L3 ⁴
6/1/2024-6/28/2024	Fleet Retrofit Pending	Unplanned	657.87	L2

F. Turbine Downtime²

Downtime (hr)	This Month	Year To Date
L1	720.00	3905.36
L2	657.87	3843.06
L3	720.00	3905.21
Total	2097.87	11653.63

G. Billed Data

Meter Reading (Date/Time)	6/26/2024 12:00 AM
Meter To Date Produced	40,626,133 kWh
Meter To Date Consumed	189,126 kWh
Last Reading Produced	40,626,133 kWh
Last Reading Consumed	176,905 kWh
Billed kWh	PENDING kWh
Next Meter Reading	7/26/2024 12:00 AM

H. Report Notes and Comments

¹ Nov totals updated from the report published Jan 18, 2024 due to an error found in the SCADA data.

² Turbine Availability/Downtime Pending.

³ As a result of previously disclosed circumstances, other than 57kWh for testing, L1 and L3 have had no energy production since 01/22/2024.

⁴ Investigation has transitioned to a Retrofit operation