


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6
Jun-23	637,000	690,482	226,931	231,165	232,387
Jul-23	518,000	381,255	124,683	125,868	130,704
Aug-23	448,000	542,148	181,375	178,264	182,509
Sep-23	617,000	359,251	114,733	121,644	122,874
Oct-23	956,000	879,647	289,457	284,843	305,347
Nov-23	1,107,000	1,168,998	394,642	378,664	395,692
Dec-23	1,098,000	967,377	303,513	327,543	336,321
Jan-24	1,251,000	922,137	311,959	310,072	300,106
Feb-24	1,044,000	0	0	0	0
Mar-24	1,119,000	0	0	0	0
Apr-24	1,116,000	0	0	0	0
May-24	876,000	0	0	0	0
Jun-24	637,000	26,101	26,101	0	0
Production 2023 (ytd) (kWh)	6,043,000	948,238	338,060	310,072	300,106
Total Production (LTM) (kWh)	10,787,000	5,246,914	1,746,463	1,726,898	1,773,553
Capacity Factor (LTM)	13.27%				

B. Site Energy Production Graph

June-2024

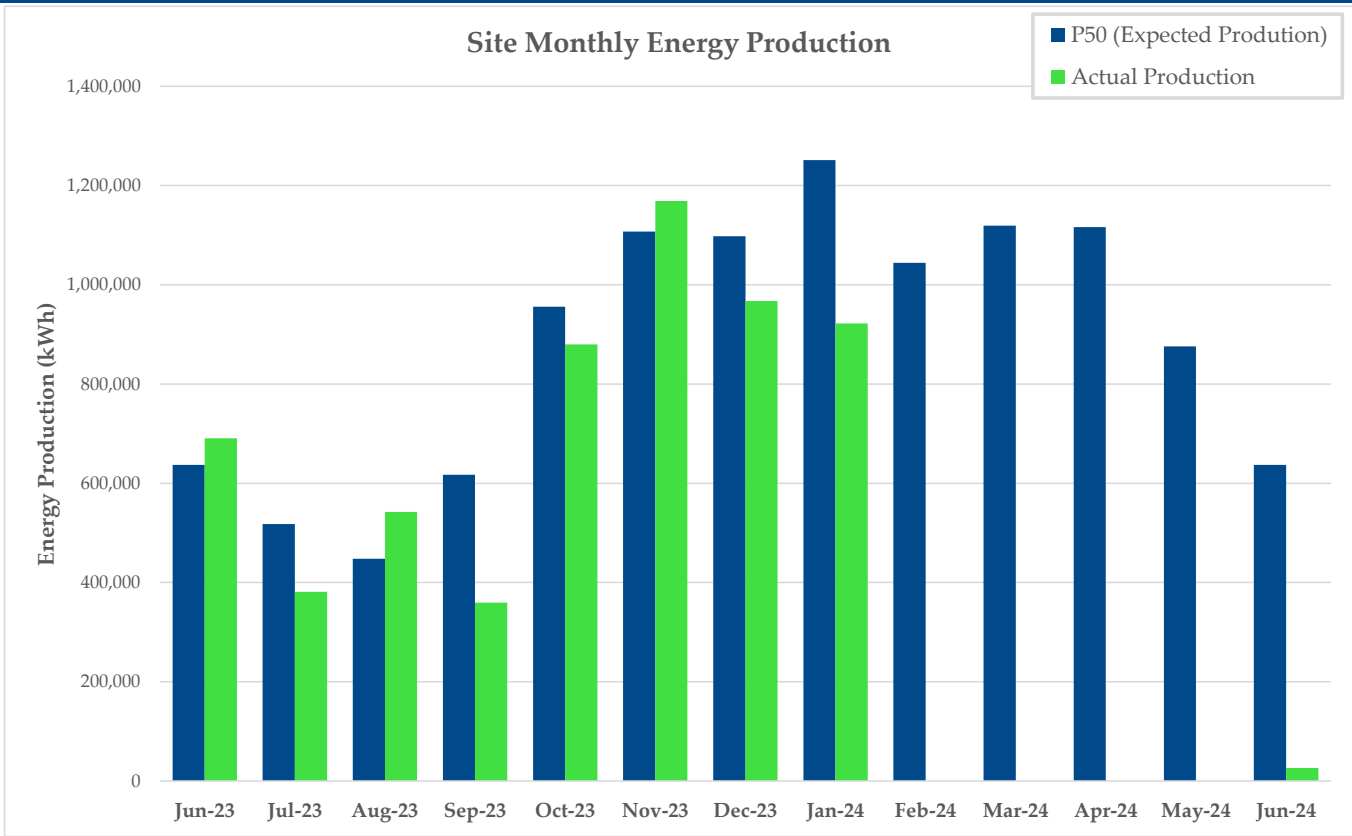

Monthly Report

June-2024

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
July-2024	3.5 Year Preventive Maintenance	~8	Z4
July-2024	3.5 Year Preventive Maintenance	~8	Z5
July-2024	3.5 Year Preventive Maintenance	~8	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
6/1/2024-6/28/2024	Fleet Retrofit Pending	Unplanned	664.13	Z4
6/1/2024-6/30/2024	Fleet Retrofit Pending	Unplanned	720	Z5 ⁴
6/1/2024-6/30/2024	Turbine Fault	Unplanned	720	Z6 ⁵

F. Turbine Downtime²

Downtime (hr)	This Month	Year To Date
Z4	664.13	3795.98
Z5	720	3851.87
Z6	720	3889.12
Total	2104.13	11536.97

G. Billed Data

Meter Reading (Date/Time)	6/19/2024 12:00 AM
Ball 2.0 Production (This Period)	0 kWh
Ball 2.0 Consumption (This Period)	1,642 kWh
Billed kWh	PENDING kWh
Next Meter Reading	7/19/2024 12:00 AM

H. Report Notes and Comments

¹ June 23 - June 25 Production is an estimate due to a SCADA server error.

² Turbine Availability/Downtime Pending.

³ As a result of previously disclosed circumstances, Z5, and Z6 has had no energy production since 01/22/2024.

⁴ Investigation has transitioned to a Retrofit operation

⁵ Z6 repair pending