



BALL CORPORATION - ZEPHYR WIND PROJECT 1.0

North Findlay Wind Campus, Findlay, OH

Monthly Report
August-2024




A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z1	Z2	Z3
Aug-23	559,000	506,843	176,172	169,047	161,624
Sep-23	482,000	324,417	116,246	107,166	101,005
Oct-23	916,000	854,774	303,388	286,219	265,167
Nov-23	1,203,000	1,181,692	413,333	399,730	368,629
Dec-23	1,475,000	932,342	325,031	323,375	283,936
Jan-24	1,260,000	897,334	312,246	300,033	285,055
Feb-24	1,310,000	0	0	0	0
Mar-24	1,140,000	0	0	0	0
Apr-24	1,359,000	290,385	101,675	110,982	77,728
May-24	856,000	675,531	232,841	224,129	218,561
Jun-24	599,000	666,365	228,319	222,302	215,744
Jul-24	549,000	408,393	144,779	135,803	127,811
Aug-24	559,000	396,364	137,674	134,332	124,358
Production 2024 (ytd) (kWh)	7,632,000	3,334,372	1,157,534	1,127,581	1,049,257
Total Production (LTM) (kWh)	11,708,000	6,627,597	2,315,532	2,244,071	2,067,994
Capacity Factor (LTM)	16.77%				

B. Site Energy Production Graph

August-2024

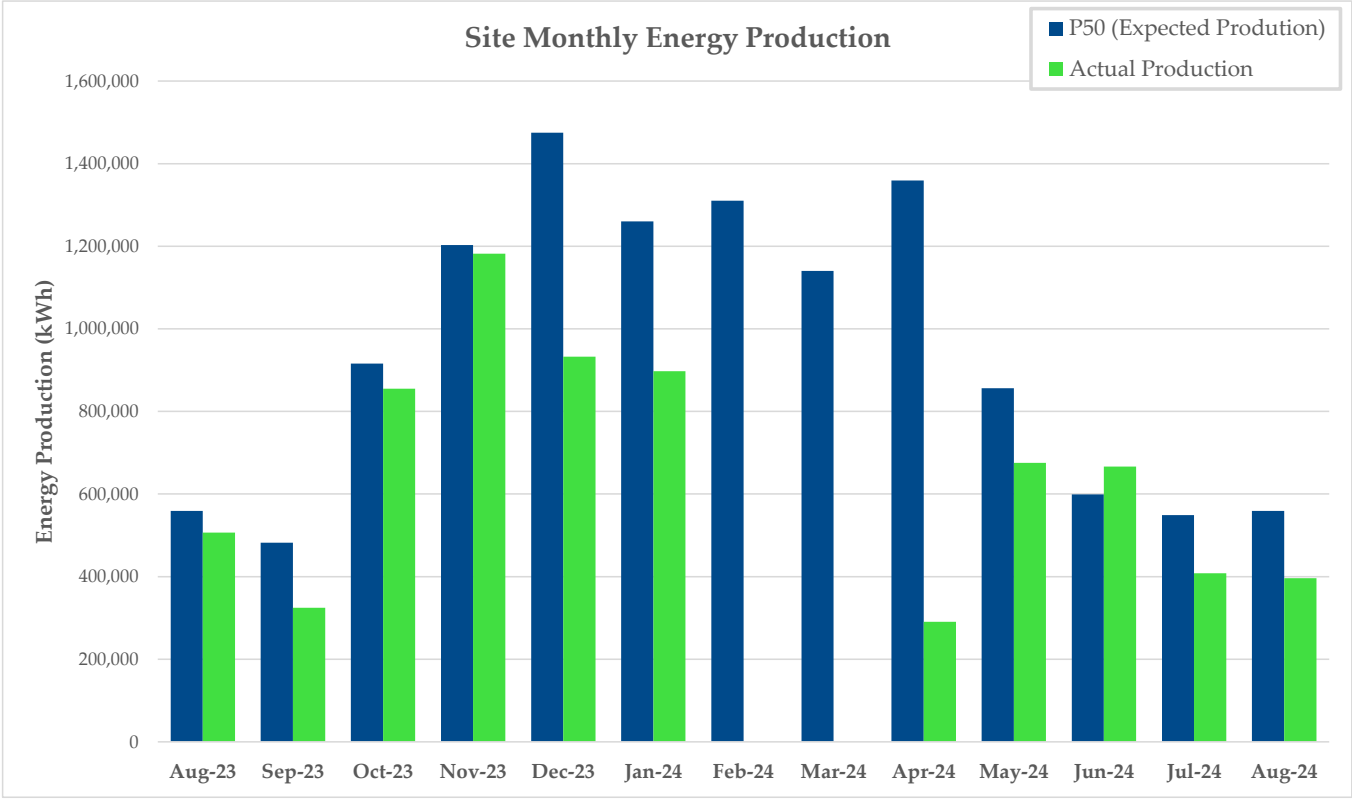

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
December-2024	8.5 Year Turbine Preventive Maintenance	~8	Z1
December-2024	8.5 Year Turbine Preventive Maintenance	~8	Z2
December-2024	8.5 Year Turbine Preventive Maintenance	~8	Z3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
8/6/2024	Weather Shutdown	Unplanned	4.01	Z1, Z2, Z3
8/7/2024	8 Year Turbine Preventive Maintenance	Planned	4.57	Z2
8/13/2024	8 Year Turbine Preventive Maintenance	Planned	8.36	Z2
8/14/2024	8 Year Turbine Preventive Maintenance	Planned	5.8	Z2
8/15/2024	8 Year Turbine Preventive Maintenance	Planned	3.81	Z3
8/19/2024	8 Year Turbine Preventive Maintenance	Planned	6.40	Z3
8/22/204	8 Year Turbine Preventive Maintenance	Planned	8.00	Z1
8/22/2024	8 Year Turbine Preventive Maintenance	Planned	7.58	Z2
8/22/2024	8 Year Turbine Preventive Maintenance	Planned	8.77	Z3
8/22/2024	Customer Shutdown	Unplanned	10.02	Z1
8/23/2024	Customer Shutdown	Unplanned	6.59	Z1

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
Z1	30.78	2258.36
Z2	31.62	2221.14
Z3	26.39	2295.70
Total	88.79	6775.20

G. Billed Data

Meter Reading (Date/Time)	8/17/2024 12:00 AM
Ball 1.0 Production (This Period)	325,314 kWh
Ball 1.0 Consumption (This Period)	2,255 kWh
Billed kWh	323,059 kWh
Next Meter Reading	9/18/2024 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² As a result of previously disclosed circumstances, the project had no energy production February 2024 - March 2024.