



BALL CORPORATION - ZEPHYR WIND PROJECT


North Findlay Wind Campus, Findlay, OH

A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50	Actual YTD	Z1	Z2	Z3
Apr-16	1,453,000	1,090,455	378,804	350,276	361,375
May-16	924,000	759,025	260,625	240,534	257,866
Jun-16	645,000	687,119	243,234	225,593	218,292
Jul-16	586,000	426,187	152,744	137,257	136,186
Aug-16	614,000	473,979	159,038	156,929	158,012
Sep-16	529,000	646,651	220,330	208,987	217,334
Oct-16	992,000	931,925	303,980	309,926	318,019
Nov-16	1,295,000	1,209,020	415,317	397,636	396,067
Dec-16	1,565,000	1,428,145	509,779	450,115	468,251
Jan-17	1,325,000	1,304,579	450,536	420,186	433,857
Feb-17	1,391,000	1,372,648	473,614	443,979	455,055
Mar-17	1,229,000	1,339,090	447,685	437,432	453,973
Apr-17	1,453,000	1,263,804	425,766	415,442	422,596
2017 Annual	12,548,000	5,280,121	1,797,601	1,717,039	1,765,481
Rolling 12 month Capacity Factor:					30.04%

B. Site Energy Production Graph

April-2017

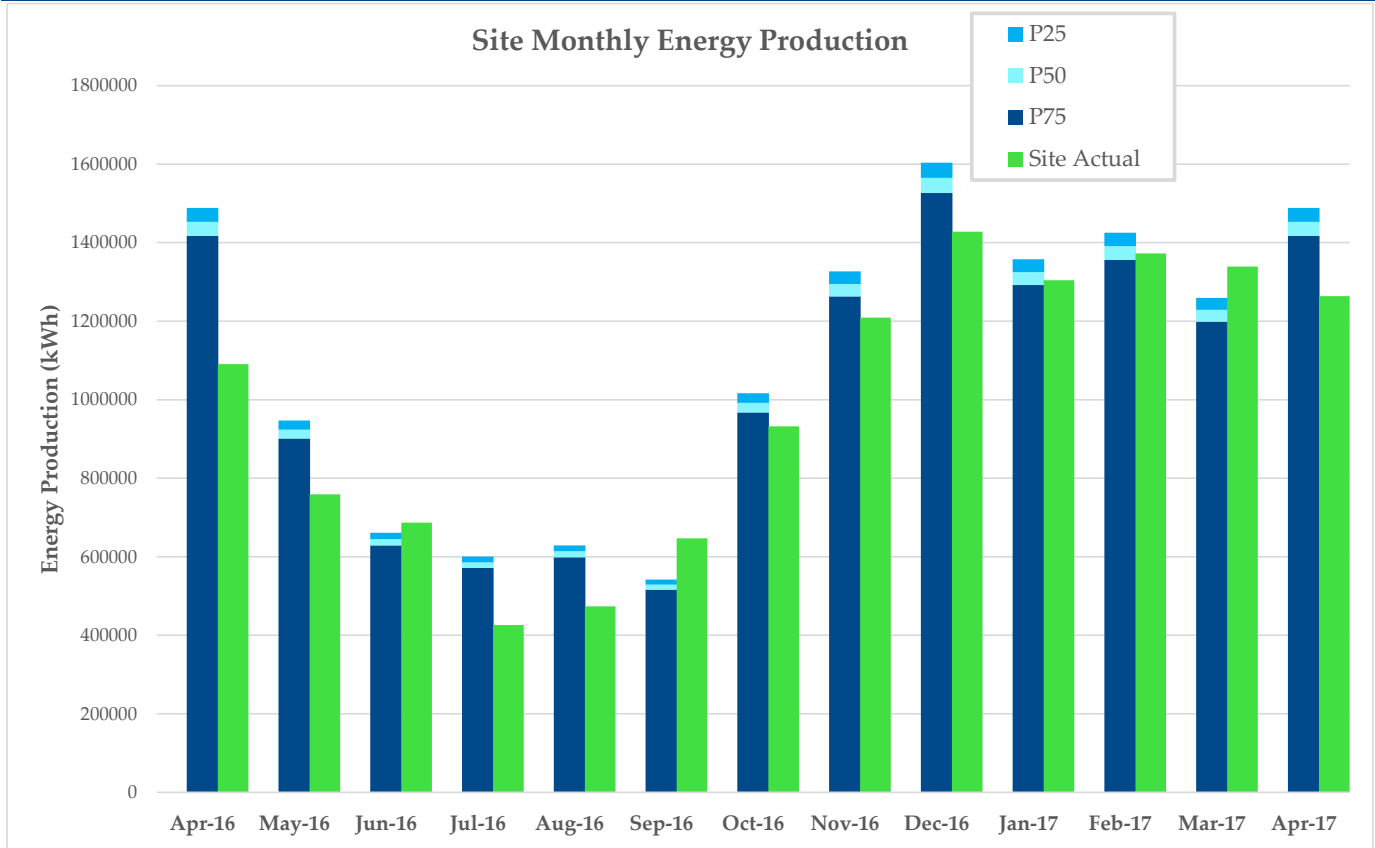

Monthly Report

April-2017



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s):	0	0
Near Miss(es):	0	0

D. Planned Maintenance Events

Date	Event	Duration (hrs)	Turbine
August-2017	Goldwind 1.5 Year Maintenance	~15	Z1
August-2017	Goldwind 1.5 Year Maintenance	~15	Z2
August-2017	Goldwind 1.5 Year Maintenance	~15	Z3

E. Actual Maintenance Events - April 2017

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
04/10-04/11/2017	Goldwind 1 Year Maintenance	Planned	9.74	Z1
4/16/2017	Grid Fault	Unplanned	9.21	Z3
4/19/2017	Tower Rescue Training	Unplanned	4.57	Z3
4/30/2017	Nacelle Acceleration Error	Unplanned	7.61	Z1

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z1	98.50%	99.03%
Z2	99.93%	98.61%
Z3	99.34%	99.53%
Avg		99.06%

Downtime (hrs)	This Month	Year To Date
Z1	24.94	68.26
Z2	10.24	113.64
Z3	15.25	67.53
Total	50.43	249.43

G. Billed Data

Meter Read Date & Time	4/19/2017 12:00 AM
Meter To Date Produced	15,288,663 kWh
Meter To Date Consumed	16,931 kWh
Last Reading Produced	14,152,165 kWh
Last Reading Consumed	16,183 kWh
Billed kWh	1,135,750 kWh
Next Meter Reading	5/19/2017 12:00 AM

H. Report Notes and Comments

- Before April-2016, actual YTD production and Capacity Factor are based off Meter Read - Net Production
- Starting in April-2016, all future YTD production and Capacity Factor will be based off SCADA Data - Gross Production