



BALL CORPORATION - ZEPHYR WIND PROJECT


North Findlay Wind Campus, Findlay, OH

A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50	Actual YTD	Z1	Z2	Z3
May-16	924,000	759,025	260,625	240,534	257,866
Jun-16	645,000	687,119	243,234	225,593	218,292
Jul-16	586,000	426,187	152,744	137,257	136,186
Aug-16	614,000	473,979	159,038	156,929	158,012
Sep-16	529,000	646,651	220,330	208,987	217,334
Oct-16	992,000	931,925	303,980	309,926	318,019
Nov-16	1,295,000	1,209,020	415,317	397,636	396,067
Dec-16	1,565,000	1,428,145	509,779	450,115	468,251
Jan-17	1,325,000	1,304,579	450,536	420,186	433,857
Feb-17	1,391,000	1,372,648	473,614	443,979	455,055
Mar-17	1,229,000	1,339,090	447,685	437,432	453,973
Apr-17	1,453,000	1,263,804	425,766	415,442	422,596
May-17	924,000	1,123,269	395,614	347,574	380,081
2017 Annual	12,548,000	6,403,390	2,193,215	2,064,613	2,145,562
Rolling 12 month Capacity Factor:					30.97%

B. Site Energy Production Graph

May-2017

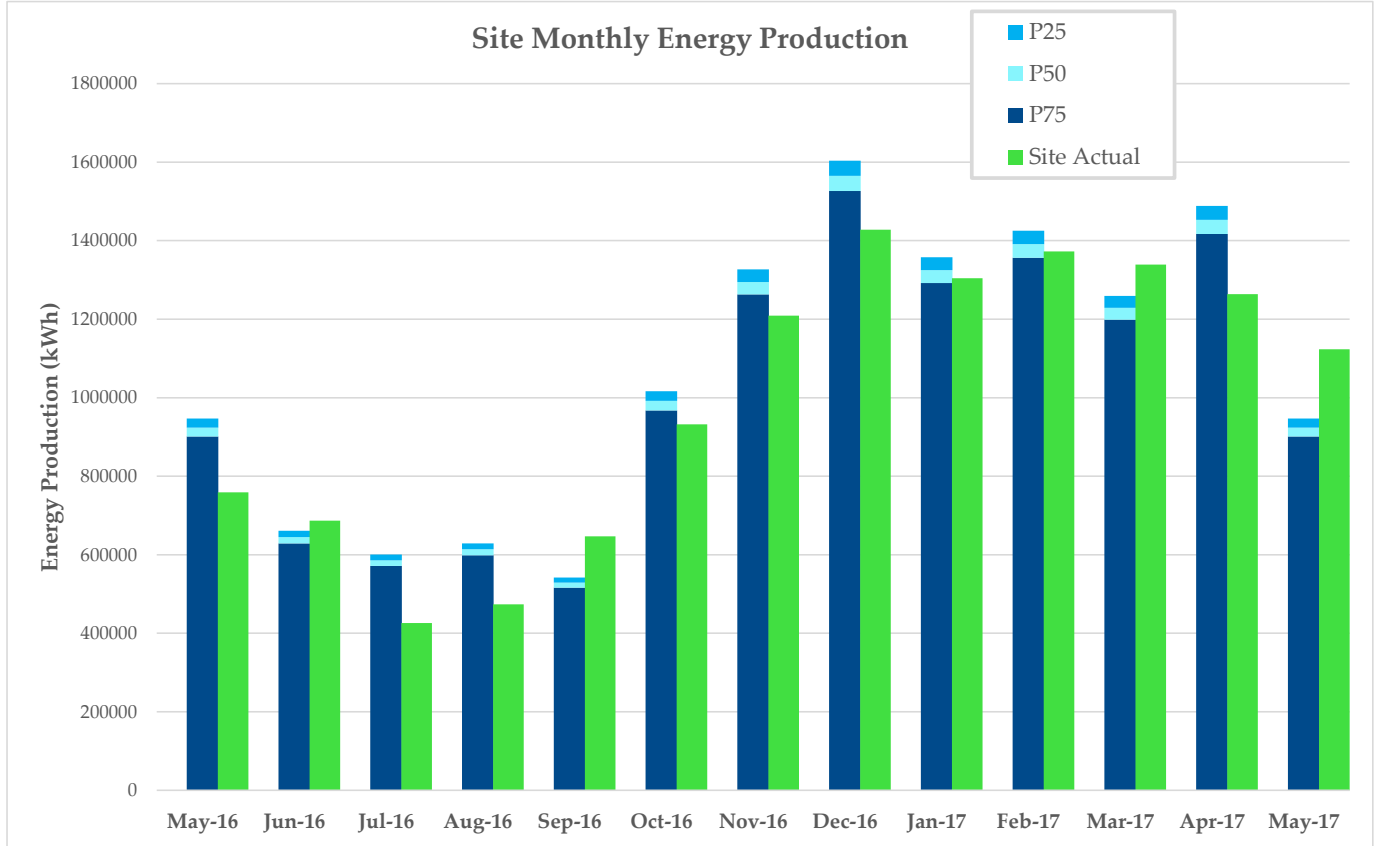

Monthly Report May-2017



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s):	0	0
Near Miss(es):	0	0

D. Planned Maintenance Events

Date	Event	Duration (hrs)	Turbine
August-2017	Goldwind 1.5 Year Maintenance	~15	Z1
August-2017	Goldwind 1.5 Year Maintenance	~15	Z2
August-2017	Goldwind 1.5 Year Maintenance	~15	Z3

E. Actual Maintenance Events - May 2017

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
5/18/2017	Device Break, Gen Speed Over Speed	Unplanned	5.01	Z2
5/19/2017	Device Break	Unplanned	4.16	Z2
5/20/2017	Device Break	Unplanned	6.33	Z2
5/26/2017	Device Break, Converter Error	Unplanned	9.73	Z2

F. Turbine Availability & Downtime

Availability	This Month	Year To Date
Z1	99.85%	99.20%
Z2	94.94%	97.85%
Z3	99.97%	99.62%
Avg	98.26%	98.89%

Downtime (hrs)	This Month	Year To Date
Z1	3.65	71.91
Z2	42.95	156.59
Z3	2.74	70.27
Total	49.34	298.77

G. Billed Data

Meter Read Date & Time	5/18/2017 12:00 AM
Meter To Date Produced	16,472,402 kWh
Meter To Date Consumed	17,546 kWh
Last Reading Produced	15,288,663 kWh
Last Reading Consumed	16,931 kWh
Billed kWh	1,183,124 kWh
Next Meter Reading	6/18/2017 12:00 AM

H. Report Notes and Comments

- Before April-2016, actual YTD production and Capacity Factor are based off Meter Read - Net Production
- Starting in April-2016, all future YTD production and Capacity Factor will be based off SCADA Data - Gross Production