



WHIRLPOOL CORPORATION WIND PROJECT


North Findlay Wind Campus, Findlay, OH

A. Site Energy Production Summary

	Energy Production (kWh)			
	Site		By Turbine	
	P50	Actual YTD	W1	W2
May-16	607,000	511,292	247,373	263,919
Jun-16	425,000	489,594	248,445	241,149
Jul-16	385,000	299,061	153,693	145,368
Aug-16	404,000	329,887	165,625	164,262
Sep-16	348,000	315,178	158,922	156,256
Oct-16	653,000	602,755	311,561	291,194
Nov-16	851,000	803,588	410,578	393,010
Dec-16	1,029,000	1,040,001	516,469	523,532
Jan-17	872,000	875,991	434,082	441,909
Feb-17	914,000	919,768	449,933	469,835
Mar-17	808,000	874,319	455,715	418,604
Apr-17	955,000	865,246	435,360	429,886
May-17	607,000	792,979	401,772	391,207
2017 Annual	8,251,000	4,328,303	2,176,862	2,151,441
Rolling 12 month Capacity Factor:				31.23%

B. Site Energy Production Graph

May-2017

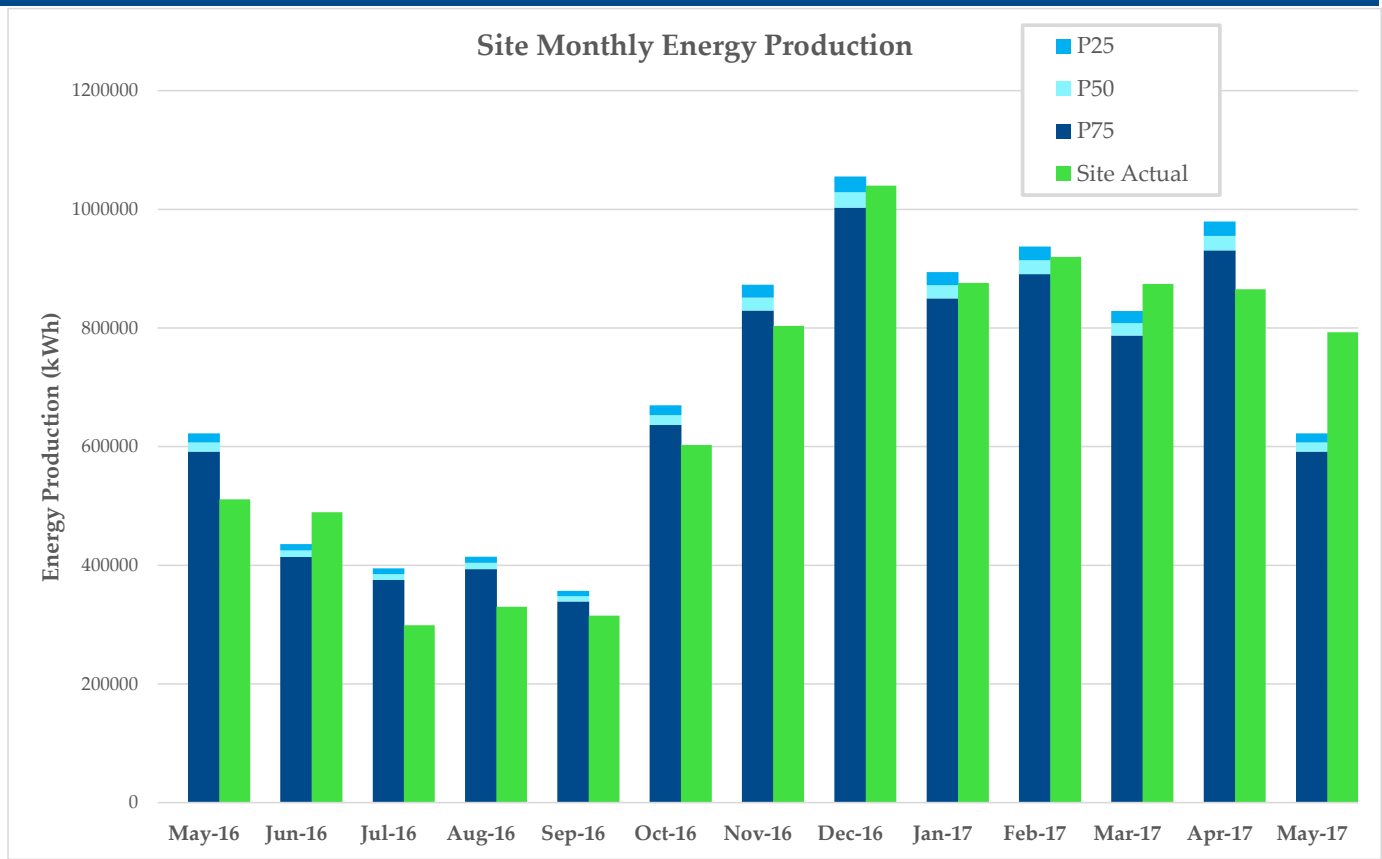

Monthly Report May-2017



C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s):	0	0
Near Miss(es):	0	0

D. Planned Maintenance Events

Date	Event	Duration (hrs)	Turbine
August-2017	Goldwind 1.5 Year Maintenance	~15	W1
August-2017	Goldwind 1.5 Year Maintenance	~15	W2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
------	-------	-------------------	----------------	---------

F. Turbine Availability & Downtime

Availability	This Month	Annual To Date
W1	99.88%	98.44%
W2	99.92%	99.65%
Avg	99.90%	99.05%
Downtime (hrs)	This Month	Annual To Date
W1	3.46	102.11
W2	3.09	48.23
Total	6.55	150.34

G. Billed Data

Meter Read Date & Time	5/28/2017 12:00 AM
Meter To Date Produced	11,379,405 kWh
Meter To Date Consumed	19,747 kWh
Last Reading Produced	10,636,594 kWh
Last Reading Consumed	19,054 kWh
Billed kWh	742,119 kWh
Next Meter Reading	6/28/2017 12:00 AM

H. Report Notes and Comments

- Before April-2016, actual YTD production and Capacity Factor are based on Meter Read - Net Production
- Starting in April-2016, all future YTD production and Capacity Factor will be based on SCADA Data - Gross Production