



BALL CORPORATION - ZEPHYR WIND PROJECT 1.0

North Findlay Wind Campus, Findlay, OH

Monthly Report
January-2025



ONE POWER COMPANY


AN INDUSTRIAL POWER COMPANY

A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z1	Z2	Z3
Jan-24	1,260,000	897,334	312,246	300,033	285,055
Feb-24	1,310,000	0	0	0	0
Mar-24	1,140,000	0	0	0	0
Apr-24	1,359,000	290,385	101,675	110,982	77,728
May-24	856,000	675,531	232,841	224,129	218,561
Jun-24	599,000	666,365	228,319	222,302	215,744
Jul-24	549,000	408,393	144,779	135,803	127,811
Aug-24	559,000	396,364	137,674	134,332	124,358
Sep-24	482,000	468,646	179,579	178,791	110,276
Oct-24	916,000	815,845	288,194	271,762	255,889
Nov-24	1,203,000	856,131	346,454	195,160	314,517
Dec-24	1,475,000	1,183,437	338,701	436,335	408,401
Jan-25	1,260,000	1,498,704	519,090	499,488	480,126
Production 2025 (ytd) (kWh)	1,260,000	1,498,704	519,090	499,488	480,126
Total Production (LTM) (kWh)	11,708,000	7,259,801	2,517,306	2,409,084	2,333,411
Capacity Factor (LTM)	18.37%				

B. Site Energy Production Graph

January-2025

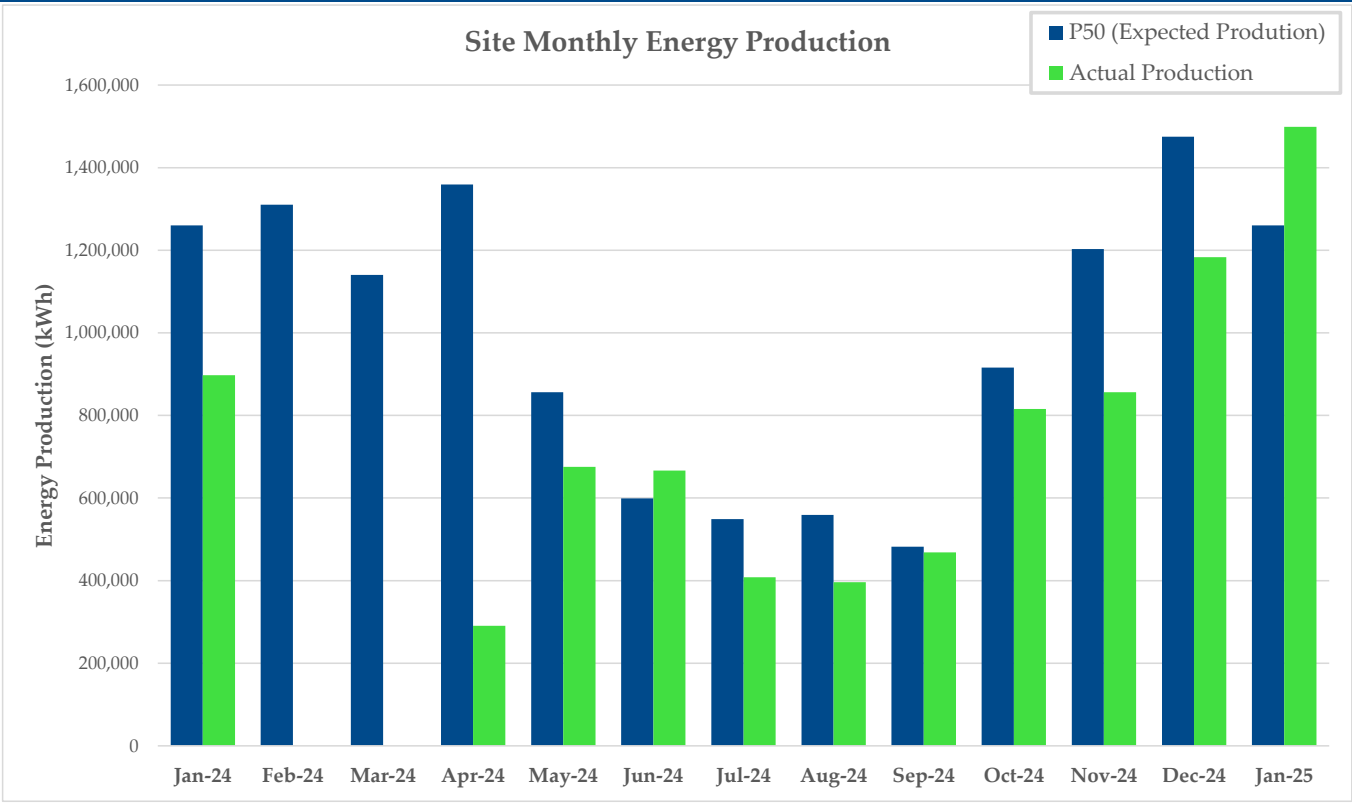

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
February-2025	8.5 Year Turbine Preventive Maintenance	~8	Z1
February-2025	8.5 Year Turbine Preventive Maintenance	~8	Z2
February-2025	8.5 Year Turbine Preventive Maintenance	~8	Z3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
1/6/2025	8.5 Year Turbine Preventive Maintenance	Planned	0.16	Z1
1/8/2025	8.5 Year Turbine Preventive Maintenance	Planned	0.41	Z1
1/8/2025	8.5 Year Turbine Preventive Maintenance	Planned	0.53	Z2
1/8/2025	8.5 Year Turbine Preventive Maintenance	Planned	0.84	Z3

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
Z1	2.29	2.29
Z2	2.85	2.85
Z3	0.84	0.84
Total	5.98	5.98

G. Billed Data

Meter Reading (Date/Time)	1/21/2025 12:00 AM
Ball 1.0 Production (This Period)	1,268,625 kWh
Ball 1.0 Consumption (This Period)	820 kWh
Billed kWh	1,267,805 kWh
Next Meter Reading	2/19/2025 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² As a result of previously disclosed circumstances, the project had no energy production February 2024 - March 2024.

³ Z1 derated to 1000 kW for 4.32 hours on Dec 17