


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6
Jan-24	1,251,000	922,137	311,959	310,072	300,106
Feb-24	1,044,000	0	0	0	0
Mar-24	1,119,000	0	0	0	0
Apr-24	1,116,000	0	0	0	0
May-24	876,000	0	0	0	0
Jun-24	637,000	26,101	26,101	0	0
Jul-24	518,000	179,993	142,016	37,977	0
Aug-24	448,000	292,342	145,491	146,851	0
Sep-24	617,000	353,095	175,829	177,266	0
Oct-24	956,000	541,507	275,869	265,638	0
Nov-24	1,107,000	688,676	335,398	353,278	0
Dec-24	1,098,000	881,937	435,966	445,971	0
Jan-25	1,251,000	1,333,065	491,894	490,120	351,051
Production 2025 (ytd) (kWh)	1,251,000	1,333,065	491,894	490,120	351,051
Total Production (LTM) (kWh)	10,787,000	4,296,716	2,028,564	1,917,101	351,051
Capacity Factor (LTM)	10.90%				

B. Site Energy Production Graph

January-2025

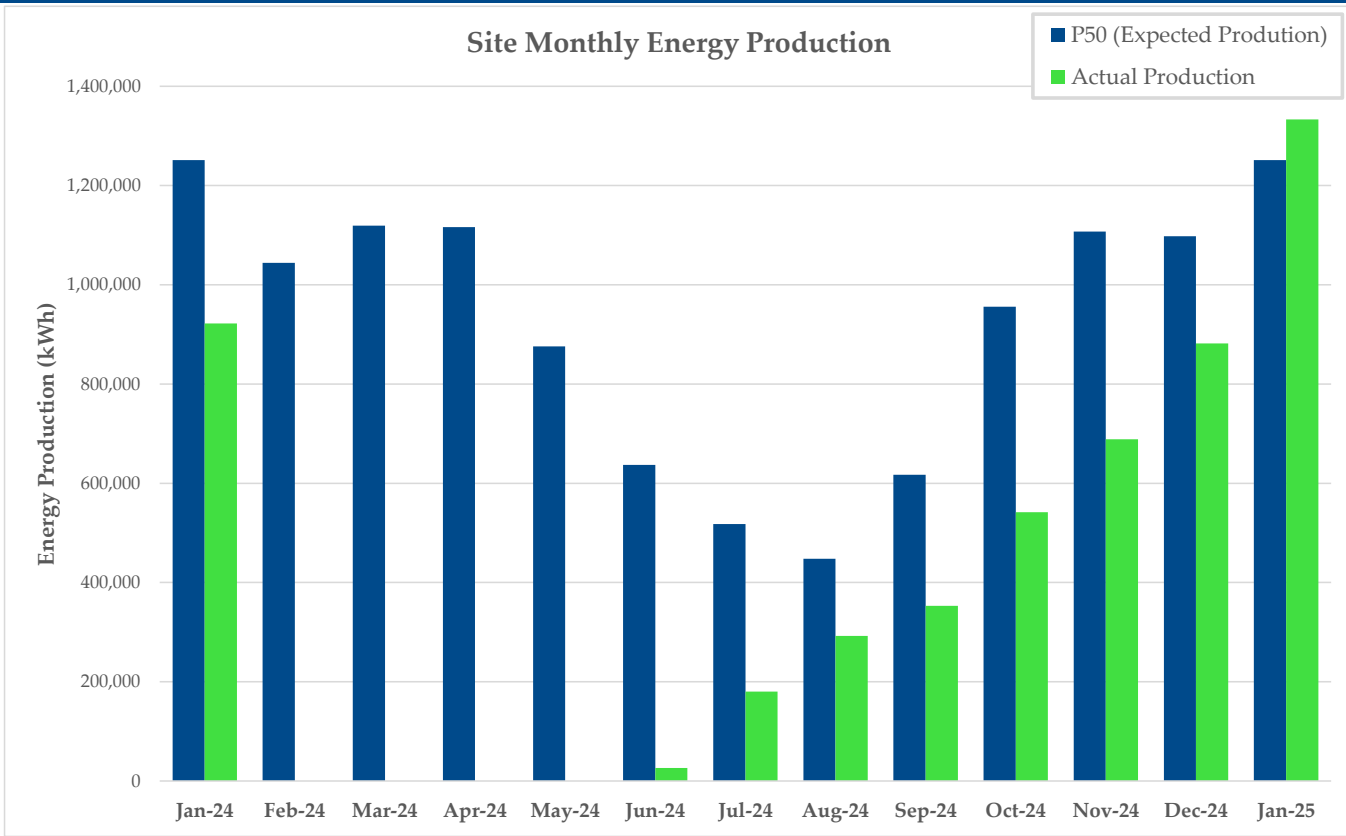

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
March-2025	4 Year Preventive Maintenance	~15	Z4
March-2025	4 Year Preventive Maintenance	~15	Z5
March-2025	4 Year Preventive Maintenance	~15	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
1/1/2025-1/6/2025	Turbine Fault	Unplanned	126.69	Z6
1/13/2025-1/14/2025	Turbine Fault	Unplanned	18.31	Z6
1/21/2025	Turbine Fault	Unplanned	5.17	Z4
1/22/2025-1/23/2025	Turbine Fault	Unplanned	22.68	Z4
1/27/2025	Turbine Fault	Unplanned	5.41	Z6

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
Z4	28.82	28.82
Z5	4.02	4.02
Z6	153.05	153.05
Total	185.89	185.89

G. Billed Data

Meter Reading (Date/Time)	1/21/2025 12:00 AM
Ball 2.0 Production (This Period)	1,018,084 kWh
Ball 2.0 Consumption (This Period)	1,902 kWh
Billed kWh	1,016,182 kWh
Next Meter Reading	2/19/2025 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² As a result of previously disclosed circumstances, the project's energy production was limited beginning 01/22/2024. Z4 resumed operation on 6/28/2024 and Z5 resumed operation on 7/23//2024.

³ Z6 Repair Complete. Resumed operation on 1/6/2025. Monthly production total includes 189 kWh from testing on 1/3/2025.