


A. Site Energy Production Summary

	Energy Production (kWh)			
	Site		By Turbine	
	P50 (Expected Production)	Actual Production	W1	W2
Jan-24	875,000	630,572	316,894	313,678
Feb-24	917,000	0	0	0
Mar-24	802,000	0	0	0
Apr-24	951,000	231,529	116,676	114,853
May-24	601,000	464,507	229,425	235,082
Jun-24	425,000	469,571	236,472	233,099
Jul-24	390,000	301,440	152,091	149,349
Aug-24	399,000	280,180	140,866	139,314
Sep-24	337,000	370,064	187,230	182,834
Oct-24	637,000	572,084	289,438	282,646
Nov-24	834,000	785,699	390,357	395,342
Dec-24	1,015,000	893,806	444,191	449,615
Jan-25	875,000	1,030,662	504,989	525,673
Production 2025 (ytd) (kWh)	875,000	1,030,662	504,989	525,673
Total Production (LTM) (kWh)	8,183,000	5,399,542	2,691,735	2,707,807
Capacity Factor (LTM)	20.49%			

B. Site Energy Production Graph

January-2025

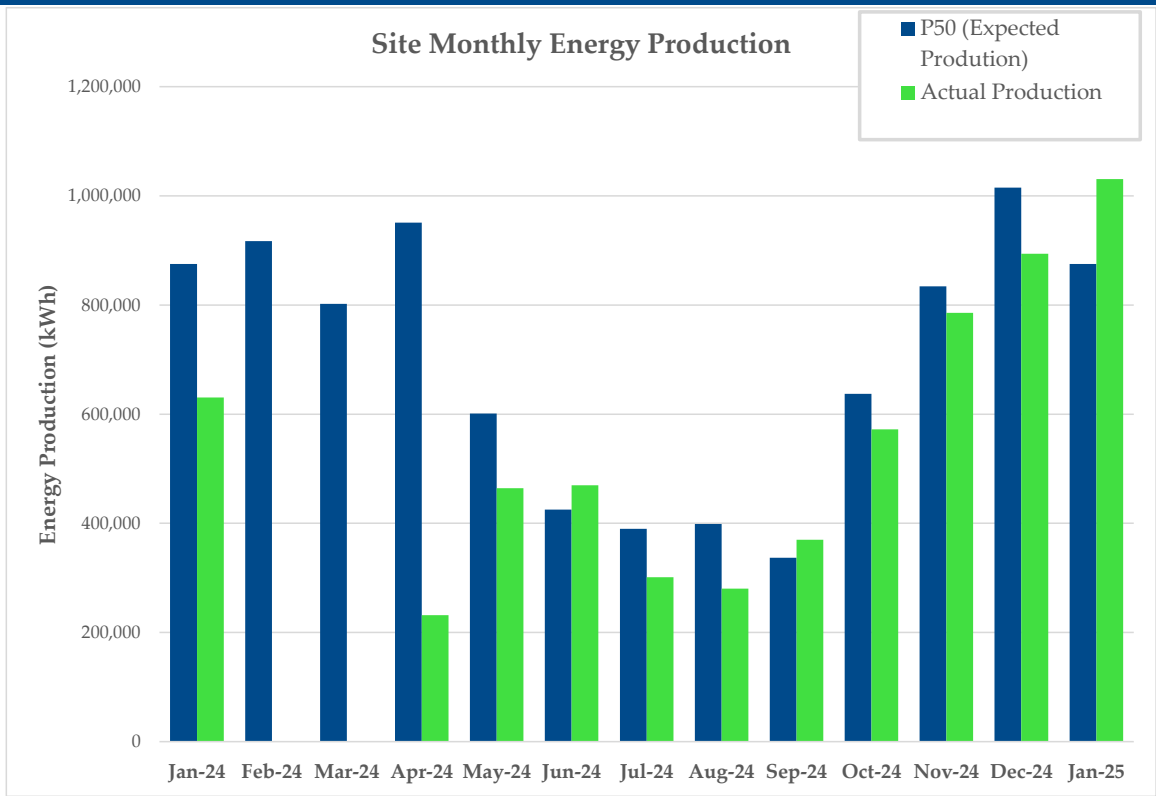

Monthly Report
January-2025

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
February-2025	9 Year Preventive Maintenance	~15	W1
February-2025	9 Year Preventive Maintenance	~15	W2

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
1/8/2025	9 Year Preventive Maintenance	Planned	1.16	W1
1/8/2025	9 Year Preventive Maintenance	Planned	0.33	W2
1/20/2025-1/21/2025	Turbine Fault	Unplanned	29.39	W1

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
W1	32.59	32.59
W2	0.69	0.69
Total	33.28	33.28

G. Billed Data

Meter Reading (Date/Time)	1/29/2025 12:00 AM
Meter To Date Produced	66,716,112 kWh
Meter To Date Consumed	156,002 kWh
Last Reading Produced	65,665,326 kWh
Last Reading Consumed	155,742 kWh
Billed kWh	1,050,526 kWh
Next Meter Reading	3/1/2025 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² As a result of previously disclosed circumstances, the project had no energy production February 2024 - March 2024.