


A. Site Energy Production Summary

	Energy Production (kWh)					
	Site		By Turbine			
	P50 (Expected Production)	Actual Production	Z4	Z5	Z6	
Feb-24	1,044,000	0	0	0	0	2
Mar-24	1,119,000	0	0	0	0	2
Apr-24	1,116,000	0	0	0	0	2
May-24	876,000	0	0	0	0	2
Jun-24	637,000	26,101	26,101	0	0	2
Jul-24	518,000	179,993	142,016	37,977	0	2
Aug-24	448,000	292,342	145,491	146,851	0	2
Sep-24	617,000	353,095	175,829	177,266	0	2
Oct-24	956,000	541,507	275,869	265,638	0	2
Nov-24	1,107,000	688,676	335,398	353,278	0	2
Dec-24	1,098,000	881,937	435,966	445,971	0	2
Jan-25	1,251,000	1,333,065	491,894	490,120	351,051	3
Feb-25	1,044,000	803,342	281,085	283,032	239,225	
Production 2025 (ytd) (kWh)	2,295,000	2,136,407	772,979	773,152	590,276	
Total Production (LTM) (kWh)	10,787,000	5,100,058	2,309,649	2,200,133	590,276	
Capacity Factor (LTM)	12.94%					

B. Site Energy Production Graph

February-2025

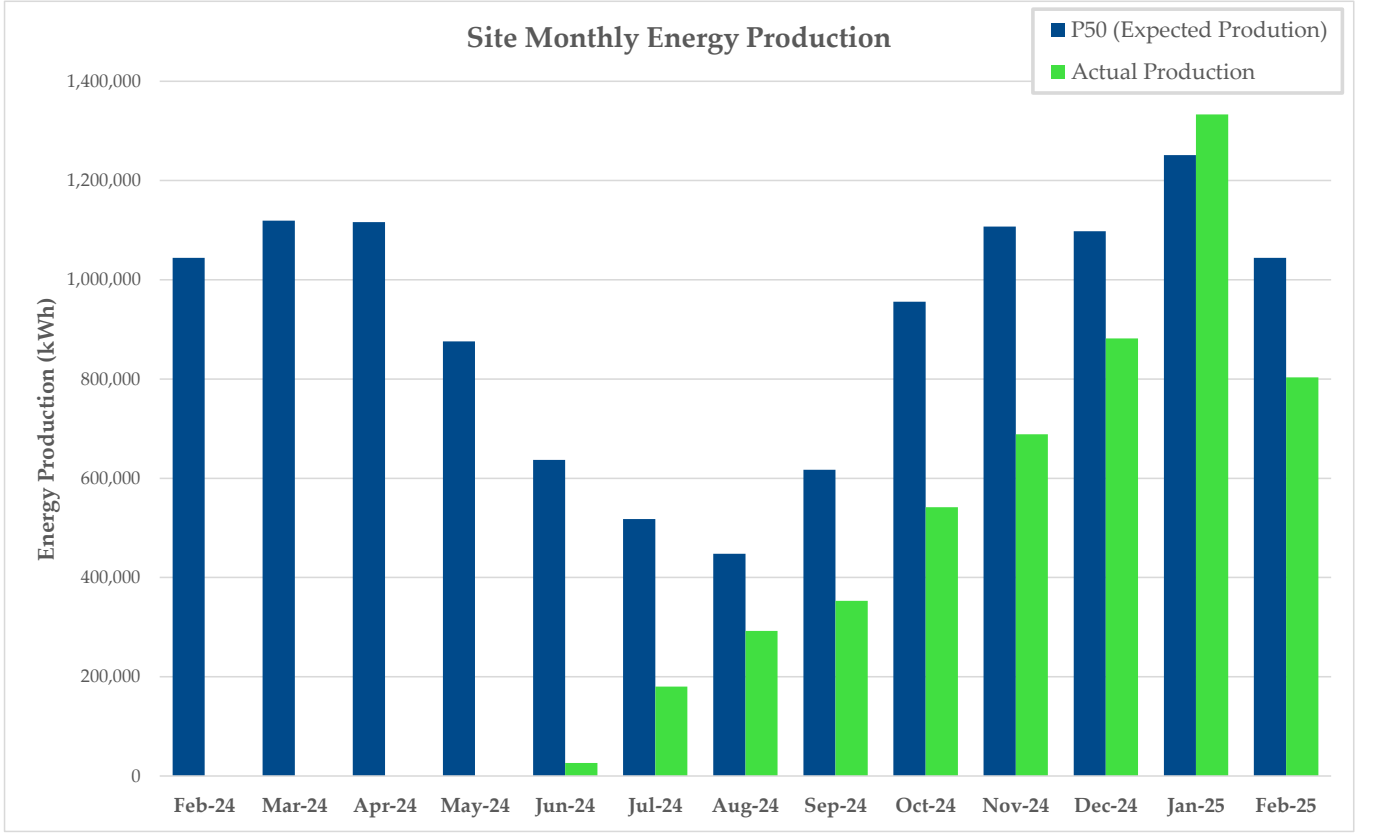

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
March-2025	4 Year Preventive Maintenance	~15	Z4
March-2025	4 Year Preventive Maintenance	~15	Z5
March-2025	4 Year Preventive Maintenance	~15	Z6

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
2/4/2025-2/5/2025	Turbine Fault	Unplanned	13.6	Z4
2/5/2025-2/6/2025	Grid Fault	Unplanned	14.84	Z5
2/6/2025	Grid Fault	Unplanned	14.37	Z4,Z6
2/8/2025-2/9/2025	Weather Shutdown	Unplanned	24.36	Z4,Z5
2/8/2025-2/10/2025	Weather Shutdown	Unplanned	44.31	Z6
2/12/2025	4 Year Preventive Maintenance	Planned	0.16	Z4
2/12/2025	4 Year Preventive Maintenance	Planned	0.12	Z5
2/12/2025	4 Year Preventive Maintenance	Planned	0.04	Z6
2/12/2025-2/13/2025	Weather Shutdown	Unplanned	19.81	Z4
2/12/2025-2/15/2025	Weather Shutdown	Unplanned	69.17	Z6
2/13/2025	Weather Shutdown	Unplanned	6.72	Z5
2/16/2025-2/17/2025	Weather Shutdown	Unplanned	26.96	Z4,Z5
2/16/2025-2/18/2025	Weather Shutdown	Unplanned	49.84	Z6
2/26/2025-2/27/2025	Turbine Fault	Unplanned	6.1	Z4

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
Z4	105.7	134.52
Z5	73	77.02
Z6	181.09	334.14
Total	359.79	545.68

G. Billed Data

Meter Reading (Date/Time)	2/19/2025 12:00 AM
Ball 2.0 Production (This Period)	925,235 kWh
Ball 2.0 Consumption (This Period)	2,002 kWh
Billed kWh	923,233 kWh
Next Meter Reading	3/20/2025 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² As a result of previously disclosed circumstances, the project's energy production was limited beginning 01/22/2024. Z4 resumed operation on 6/28/2024 and Z5 resumed operation on 7/23//2024.

³ Z6 Repair Complete. Resumed operation on 1/6/2025. Monthly production total includes 189 kWh from testing on 1/3/2025.