


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	WG1	WG2	WG3
Mar-24	1,312,000	0	0	0	0
Apr-24	1,272,000	165,611	81,100	0	84,511
May-24	974,000	443,966	224,384	0	219,582
Jun-24	714,000	457,519	234,750	0	222,769
Jul-24	566,000	306,010	138,508	26,329	141,173
Aug-24	514,000	412,680	141,710	134,341	136,629
Sep-24	716,000	531,587	183,534	168,417	179,636
Oct-24	1,051,000	881,013	307,605	290,645	282,763
Nov-24	1,224,000	1,122,327	391,525	369,519	361,283
Dec-24	1,217,000	1,260,023	446,812	416,052	397,159
Jan-25	1,343,000	1,398,943	512,624	450,432	435,887
Feb-25	1,133,000	710,891	253,926	229,140	227,825
Mar-25	1,312,000	1,642,126	558,314	545,778	538,034
Production 2025 (ytd) (kWh)	3,788,000	3,751,960	1,324,864	1,225,350	1,201,746
Total Production (LTM) (kWh)	12,036,000	9,332,696	3,474,792	2,630,653	3,227,251
Capacity Factor (LTM)	23.68%				

B. Site Energy Production Graph

March-2025

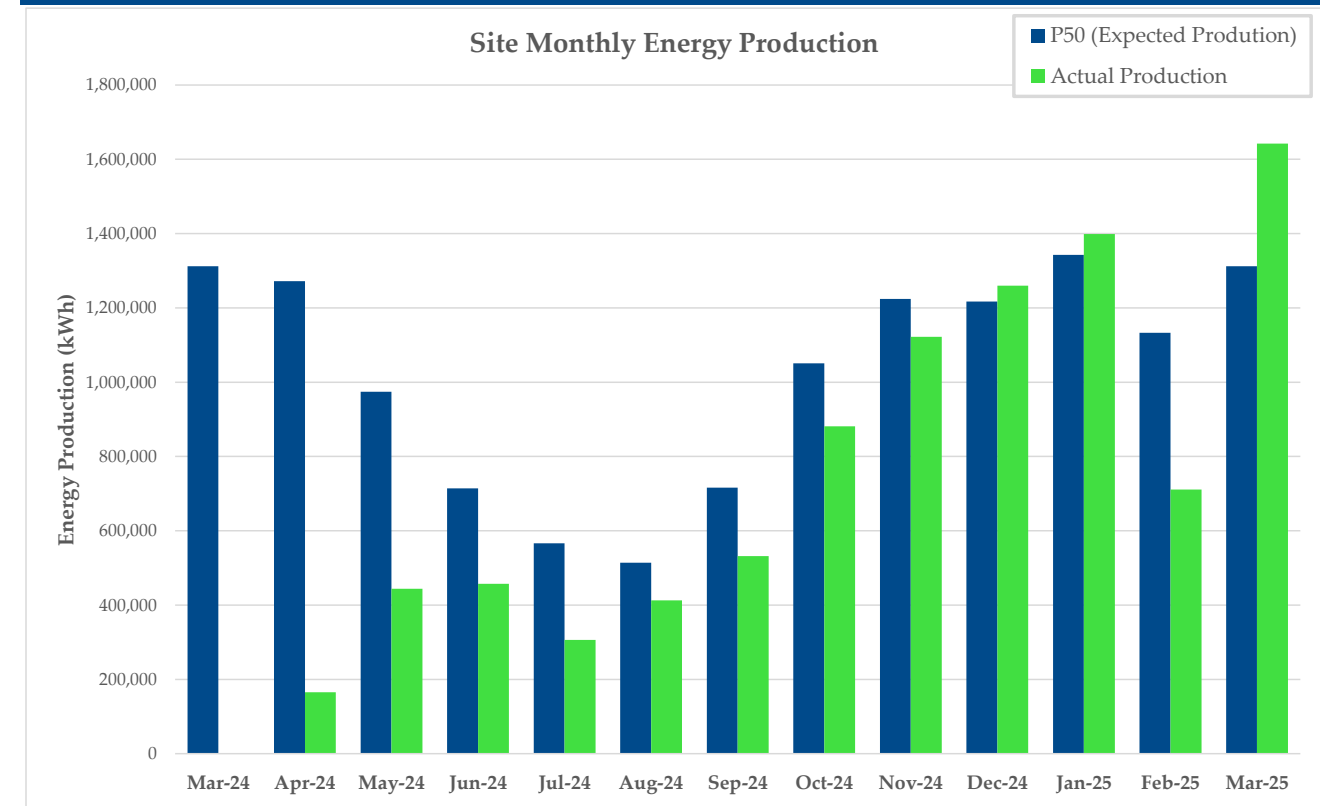

Monthly Report
March-2025

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2025	6.5 Year Preventive Maintenance	~8	WG 1
September-2025	6.5 Year Preventive Maintenance	~8	WG 2
April-2025	6 Year Preventive Maintenance	~15	WG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
3/19/2025	6 Year Preventive Maintenance	Planned	4.36	WG 1
3/19/2025	6 Year Preventive Maintenance	Planned	4.03	WG 2
3/19/2025	6 Year Preventive Maintenance	Planned	2.72	WG 3
3/31/2025	6 Year Preventive Maintenance	Planned	4.33	WG 1
3/31/2025	Customer Shutdown - Repair Pending	Unplanned	12.28	WG 1

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
WG1	21.39	179.45
WG2	4.24	163.61
WG3	2.93	179.23
`	28.56	522.29

G. Billed Data

Meter Reading (Date/Time)	3/29/2025 12:00 AM
Meter To Date Produced	65,717,473 kWh
Meter To Date Consumed	275,226 kWh
Last Reading Produced	64,244,280 kWh
Last Reading Consumed	273,768 kWh
Billed kWh	1,471,735 kWh
Next Meter Reading	4/29/2025 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² As a result of previously disclosed circumstances, the project had no energy production February 2024 - March 2024.

³ As a result of previously disclosed circumstances, WG 2 had no energy production February 2024 - June 2024.

⁴ W2 was derated to 250 KW for .62hrs on Feb 13 for testing