


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Mar-24	1,134,000	0	0	0	0
Apr-24	1,176,000	269,672	87,026	88,258	94,388
May-24	927,000	533,339	180,109	172,157	181,073
Jun-24	634,000	512,583	178,220	152,008	182,355
Jul-24	527,000	347,033	118,853	106,389	121,791
Aug-24	449,000	293,672	100,620	93,127	99,925
Sep-24	610,000	401,369	130,058	125,317	145,994
Oct-24	990,000	624,977	226,024	151,986	246,967
Nov-24	1,123,000	1,012,898	346,441	326,379	340,078
Dec-24	1,153,000	890,936	306,203	296,619	288,114
Jan-25	1,306,000	1,219,137	428,208	389,061	401,868
Feb-25	1,137,000	646,378	234,980	200,956	210,442
Mar-25	1,134,000	1,354,053	450,894	486,025	417,134
Production 2025 (ytd) (kWh)	3,577,000	3,219,568	1,114,082	1,076,042	1,029,444
Total Production (LTM) (kWh)	11,166,000	8,106,047	2,787,636	2,588,282	2,730,129
Capacity Factor (LTM)	20.56%				

B. Site Energy Production Graph

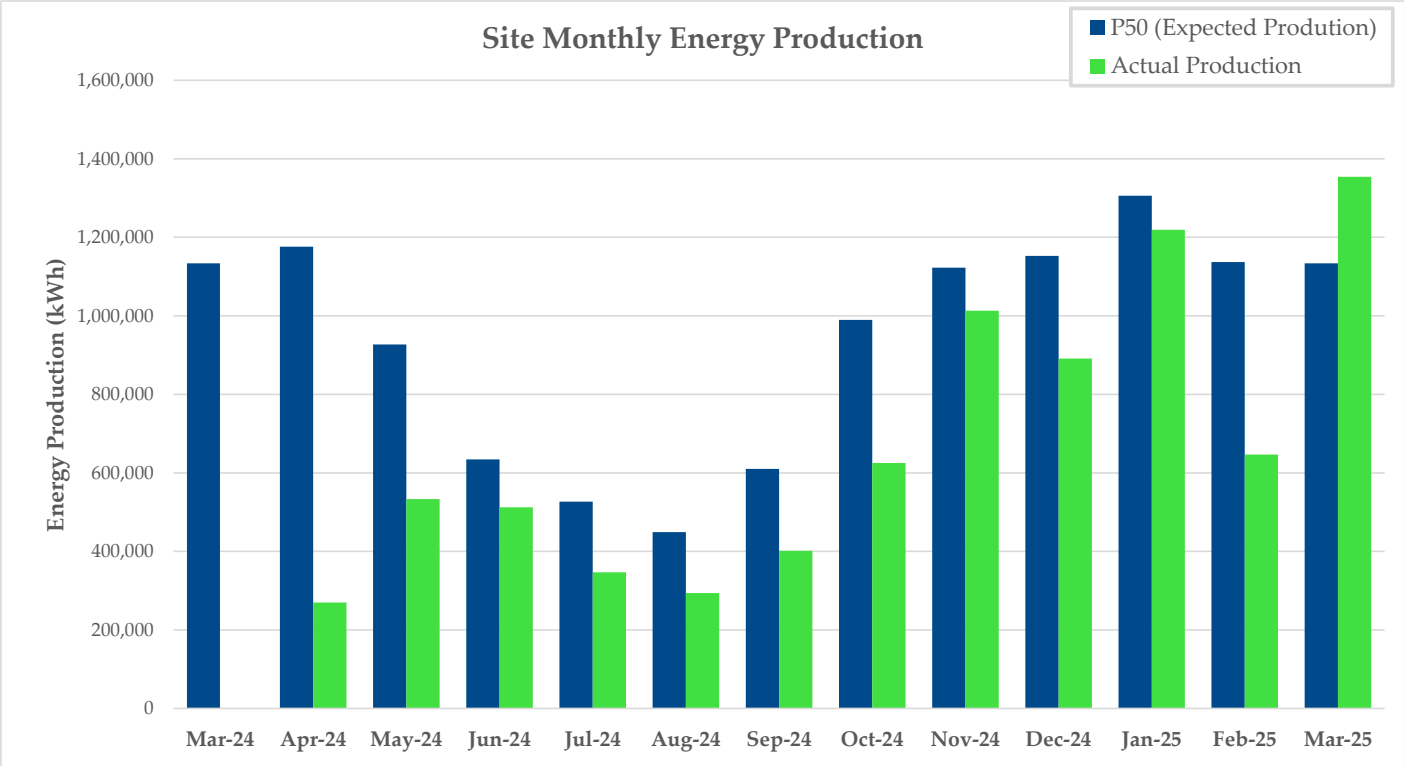

Monthly Report
March-2025

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2025	7.5 Year Preventive Maintenance	~8	W1
September-2025	7.5 Year Preventive Maintenance	~8	W2
September-2025	7.5 Year Preventive Maintenance	~8	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
3/14/2025-3/18/2025	Turbine Fault	Unplanned	95.7	W3
3/17/2025	7 Year Preventive Maintenance	Planned	4.7	W2
3/18/2025	7 Year Preventive Maintenance	Planned	6	W3
3/20/2025	7 Year Preventive Maintenance	Planned	3.30	W1
3/21/2025	7 Year Preventive Maintenance	Planned	4.38	W1

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
W1	15.88	127.67
W2	14.06	142.67
W3	108.52	242.58
Total	138.46	512.92

G. Billed Data

Meter Reading (Date/Time)	3/21/2025 12:00 AM
Meter To Date Produced	64,709,010 kWh
Meter To Date Consumed	218,054 kWh
Last Reading Produced	63,615,615 kWh
Last Reading Consumed	217,107 kWh
Billed kWh	1,092,448 kWh
Next Meter Reading	4/21/2025 12:00 AM

H. Report Notes and Comments

¹Turbine Availability/Downtime Pending

²As a result of previously disclosed circumstances, the project had no energy prodction February 2024-March 2024.

³ W1 derated to 1000 kW for 142.2 hrs from October 2024 - February 2025

³ W2 derated to 1000 kW for 48.01 hrs in October 2024

³W2 derated to 800 kW for 21.6 hrs in October 2024

³W3 derated to 1000 kW for 25 hrs in November 2024

³W1 derated to 1000 kW for 30.6 hrs from March 1 - March 2 and for 40.97 hrs from March 5 - March 6

³W1 derated to 1000 kW for 5.25 hrs from March 11 - March 12 and for 44 hrs from March 14 - March 16

³W1 derated to 1000 kW for 38.55 hrs from March 11 - March 12 and for 57.17 hrs from March 20 - March 22

³W1 derated to 1000 kW for 90.45 hrs from March 23 - March 27 and for 6.42 hrs on March 29

³W1 derated to 1000 kW for 14.07 hrs from March 30 - March 31 and for 2.2 hrs on March 31

³W1 derated to 1100 kW for 2.67 hrs on March 31

³W1 derated to 1200 kW for 1.28 hrs on March 31

³W1 derated to 1300 kW for 1.1 hrs on March 31