



BALL CORPORATION - ZEPHYR WIND PROJECT 1.0

North Findlay Wind Campus, Findlay, OH

Monthly Report

April-2025




A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	Z1	Z2	Z3
Apr-24	1,359,000	290,385	101,675	110,982	77,728
May-24	856,000	675,531	232,841	224,129	218,561
Jun-24	599,000	666,365	228,319	222,302	215,744
Jul-24	549,000	408,393	144,779	135,803	127,811
Aug-24	559,000	396,364	137,674	134,332	124,358
Sep-24	482,000	468,646	179,579	178,791	110,276
Oct-24	916,000	815,845	288,194	271,762	255,889
Nov-24	1,203,000	856,131	346,454	195,160	314,517
Dec-24	1,475,000	1,183,437	338,701	436,335	408,401
Jan-25	1,260,000	1,498,704	519,090	499,488	480,126
Feb-25	1,310,000	777,633	278,062	278,866	220,705
Mar-25	1,140,000	1,627,608	577,430	552,966	497,212
Apr-25	1,359,000	1,017,888	335,455	344,738	337,695
Production 2025 (ytd) (kWh)	5,069,000	4,921,833	1,710,037	1,676,058	1,535,738
Total Production (LTM) (kWh)	11,708,000	10,392,545	3,606,578	3,474,672	3,311,295
Capacity Factor (LTM)	26.36%				

B. Site Energy Production Graph

April-2025

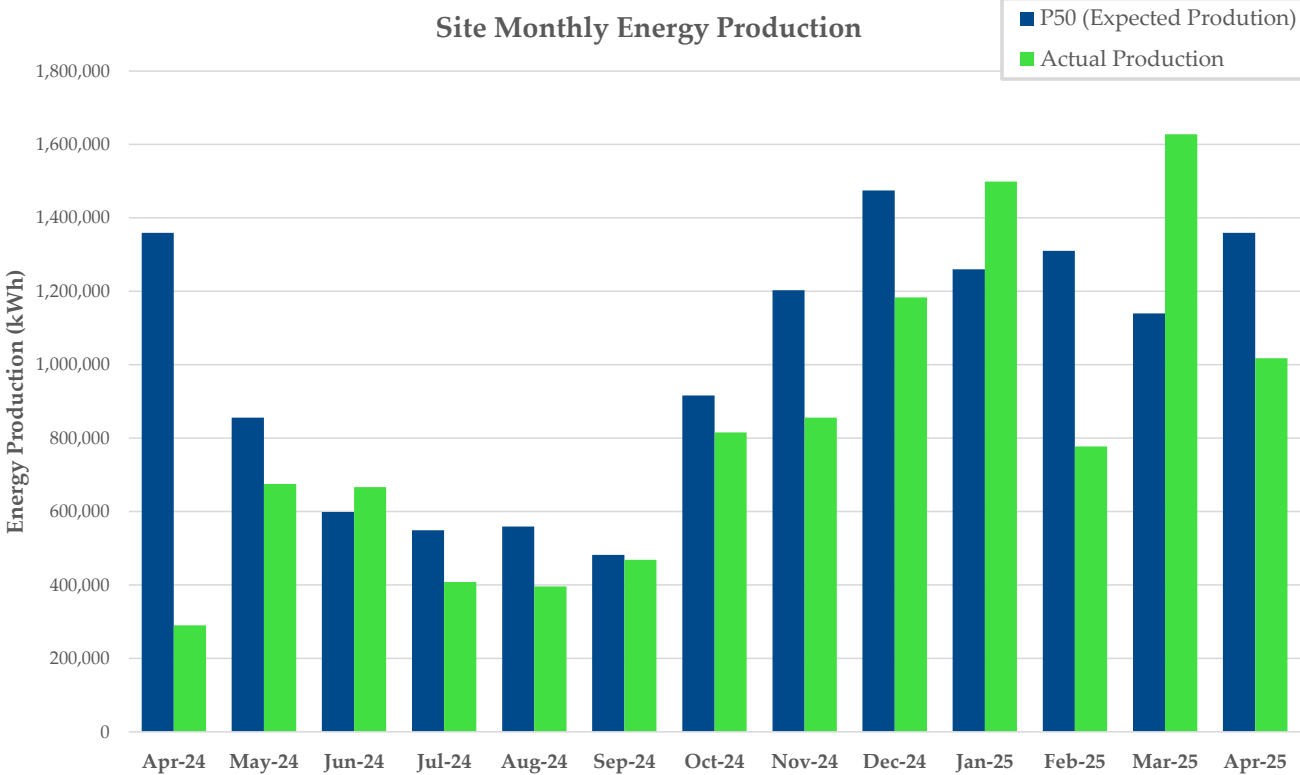

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
July-2025	9 Year Turbine Preventive Maintenance	~15	Z1
July-2025	9 Year Turbine Preventive Maintenance	~15	Z2
July-2025	9 Year Turbine Preventive Maintenance	~15	Z3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
4/2/2025-4/3/2025	Weather Shutdown	Unplanned	5.08	Z1,Z2,Z3
4/3/2025	Customer Shutdown	Unplanned	8.11	Z2
4/4/2025	Customer Shutdown	Unplanned	4.66	Z2
4/17/2025-4/18/2025	Turbine Fault	Unplanned	25.08	Z1
4/28/2025-4/29/2025	Turbine Fault	Unplanned	6.23	Z1

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
Z1	40.02	174.34
Z2	21.75	101.06
Z3	8.24	186.95
Total	70.01	462.35

G. Billed Data

Meter Reading (Date/Time)	4/18/2025 12:00 AM
Ball 1.0 Production (This Period)	1,065,673 kWh
Ball 1.0 Consumption (This Period)	636 kWh
Billed kWh	1,065,037 kWh
Next Meter Reading	5/20/2025 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² Z1 derated to 1000 kW for 4.32 hours on Dec 17