


A. Site Energy Production Summary

| | Energy Production (kWh) | | | | |
|------------------------------|---------------------------|-------------------|------------|-----------|-----------|
| | Site | | By Turbine | | |
| | P50 (Expected Production) | Actual Production | W1 | W2 | W3 |
| Apr-24 | 1,176,000 | 269,672 | 87,026 | 88,258 | 94,388 |
| May-24 | 927,000 | 533,339 | 180,109 | 172,157 | 181,073 |
| Jun-24 | 634,000 | 512,583 | 178,220 | 152,008 | 182,355 |
| Jul-24 | 527,000 | 347,033 | 118,853 | 106,389 | 121,791 |
| Aug-24 | 449,000 | 293,672 | 100,620 | 93,127 | 99,925 |
| Sep-24 | 610,000 | 401,369 | 130,058 | 125,317 | 145,994 |
| Oct-24 | 990,000 | 624,977 | 226,024 | 151,986 | 246,967 |
| Nov-24 | 1,123,000 | 1,012,898 | 346,441 | 326,379 | 340,078 |
| Dec-24 | 1,153,000 | 890,936 | 306,203 | 296,619 | 288,114 |
| Jan-25 | 1,306,000 | 1,219,137 | 428,208 | 389,061 | 401,868 |
| Feb-25 | 1,137,000 | 646,378 | 234,980 | 200,956 | 210,442 |
| Mar-25 | 1,134,000 | 1,354,053 | 450,894 | 486,025 | 417,134 |
| Apr-25 | 1,176,000 | 1,009,486 | 337,030 | 330,554 | 341,902 |
| Production 2025 (ytd) (kWh) | 4,753,000 | 4,229,054 | 1,451,112 | 1,406,596 | 1,371,346 |
| Total Production (LTM) (kWh) | 11,166,000 | 8,845,861 | 3,037,640 | 2,830,578 | 2,977,643 |
| Capacity Factor (LTM) | 22.44% | | | | |

B. Site Energy Production Graph

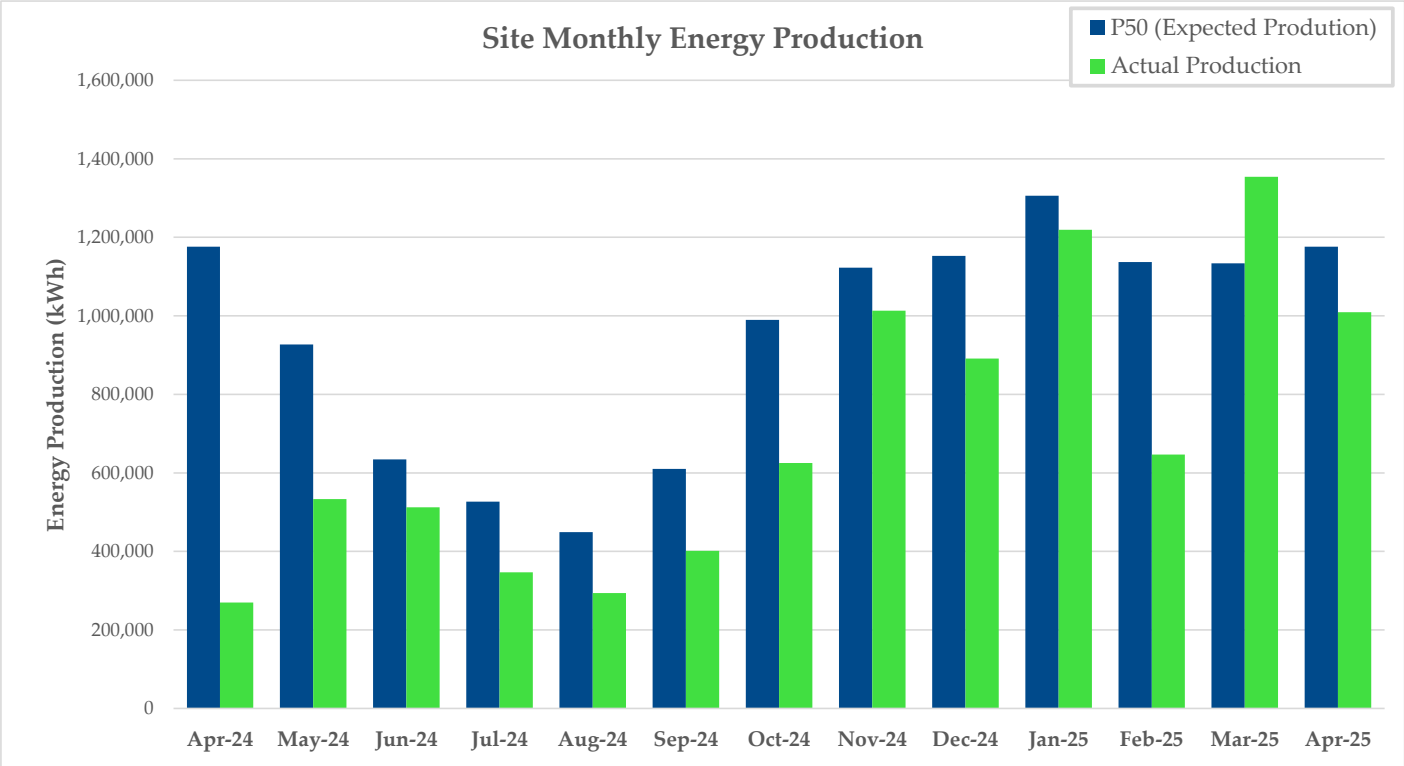

Monthly Report
April-2025

C. Safety Summary

| | This Month | Project Cumulative |
|------------------------|------------|--------------------|
| Recordable Incident(s) | 0 | 0 |
| First Aid | 0 | 1 |

D. Planned Maintenance Events

| Date | Event | Duration (hr) | Turbine |
|----------------|---------------------------------|---------------|---------|
| September-2025 | 7.5 Year Preventive Maintenance | ~15 | W1 |
| September-2025 | 7.5 Year Preventive Maintenance | ~15 | W2 |
| September-2025 | 7.5 Year Preventive Maintenance | ~15 | W3 |

E. Actual Maintenance Events

| Date | Event | Planned/Unplanned | Duration (hrs) | Turbine |
|-------------------|--------------------|-------------------|----------------|------------|
| 4/2/2025-4/3/2025 | Weather Shutdown | Unplanned | 4.76 | W1, W2, W3 |
| 4/3/2025 | Turbine Inspection | Unplanned | 7.36 | W1 |
| 4/6/2025-4/7/2025 | Turbine Fault | Unplanned | 6.8 | W2 |

F. Turbine Downtime¹

| Downtime (hr) | This Month | Year To Date |
|---------------|------------|--------------|
| W1 | 13.44 | 141.11 |
| W2 | 12.65 | 155.32 |
| W3 | 7.05 | 249.63 |
| Total | 33.14 | 546.06 |

G. Billed Data

| | |
|---------------------------|--------------------|
| Meter Reading (Date/Time) | 4/21/2025 12:00 AM |
| Meter To Date Produced | 65,865,498 kWh |
| Meter To Date Consumed | 219,577 kWh |
| Last Reading Produced | 64,709,010 kWh |
| Last Reading Consumed | 218,054 kWh |
| Billed kWh | 1,154,965 kWh |
| Next Meter Reading | 5/21/2025 12:00 AM |

H. Report Notes and Comments

¹Turbine Availability/Downtime Pending

² W1 derated to 1000 kW for 142.2 hrs from October 2024 - February 2025

² W2 derated to 1000 kW for 48.01 hrs in October 2024

² W2 derated to 800 kW for 21.6 hrs in October 2024

² W3 derated to 1000 kW for 25 hrs in November 2024

² W1 derated to 1000 kW for 30.6 hrs from March 1 - March 2 and for 40.97 hrs from March 5 - March 6

² W1 derated to 1000 kW for 5.25 hrs from March 11 - March 12 and for 44 hrs from March 14 - March 16

² W1 derated to 1000 kW for 38.55 hrs from March 11 - March 12 and for 57.17 hrs from March 20 - March 22

² W1 derated to 1000 kW for 90.45 hrs from March 23 - March 27 and for 6.42 hrs on March 29

² W1 derated to 1000 kW for 14.07 hrs from March 30 - March 31 and for 2.2 hrs on March 31

² W1 derated to 1100 kW for 2.67 hrs on March 31

² W1 derated to 1200 kW for 1.28 hrs on March 31

² W1 derated to 1300 kW for 1.1 hrs on March 31

² W1 derated to 1100 kW for 1.13 hrs on April 2

² W1 derated to 1200 kW for 29.03 from April 2 - April 3