


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	WG1	WG2	WG3
Apr-24	1,272,000	165,611	81,100	0	84,511 ²
May-24	974,000	443,966	224,384	0	219,582 ²
Jun-24	714,000	457,519	234,750	0	222,769 ²
Jul-24	566,000	306,010	138,508	26,329	141,173
Aug-24	514,000	412,680	141,710	134,341	136,629
Sep-24	716,000	531,587	183,534	168,417	179,636
Oct-24	1,051,000	881,013	307,605	290,645	282,763
Nov-24	1,224,000	1,122,327	391,525	369,519	361,283
Dec-24	1,217,000	1,260,023	446,812	416,052	397,159
Jan-25	1,343,000	1,398,943	512,624	450,432	435,887
Feb-25	1,133,000	710,891	253,926	229,140	227,825 ³
Mar-25	1,312,000	1,642,126	558,314	545,778	538,034
Apr-25	1,272,000	1,161,033	398,359	383,282	379,392
Production 2025 (ytd) (kWh)	5,060,000	4,912,993	1,723,223	1,608,632	1,581,138
Total Production (LTM) (kWh)	12,036,000	10,328,118	3,792,051	3,013,935	3,522,132
Capacity Factor (LTM)	26.20%				

B. Site Energy Production Graph

April-2025

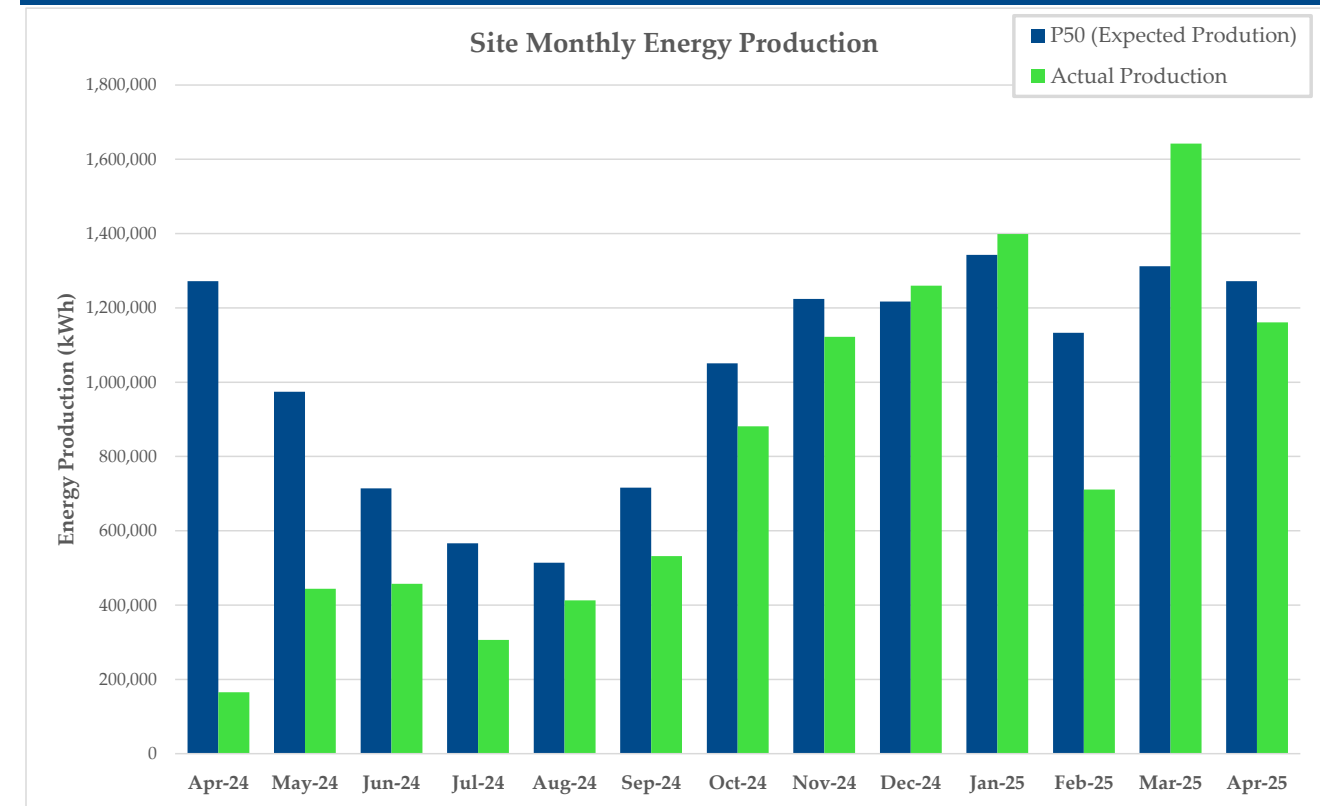

Monthly Report
April-2025

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
July-2025	6.5 Year Preventive Maintenance	~15	WG 1
July-2025	6.5 Year Preventive Maintenance	~15	WG 2
July-2025	6.5 Year Preventive Maintenance	~15	WG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
4/1/2025	Customer Shutdown	Unplanned	12.96	WG 1
4/1/2025	6 Year Preventive Maintenance	Planned	4.83	WG2
4/2/2025	Weather Shutdown	Unplanned	6.06	WG1, WG 2, WG3
4/4/2025	6 Year Preventive Maintenance	Planned	3.46	WG 3
4/22/2025	Blade Inspection	Unplanned	4.94	WG 1

F. Turbine Downtime¹

Downtime (hr)	This Month	Year To Date
WG1	26.78	206.23
WG2	13.93	177.54
WG3	12.91	192.14
`	53.62	575.91

G. Billed Data

Meter Reading (Date/Time)	4/29/2025 12:00 AM
Meter To Date Produced	66,943,253 kWh
Meter To Date Consumed	277,285 kWh
Last Reading Produced	65,717,473 kWh
Last Reading Consumed	275,226 kWh
Billed kWh	1,223,721 kWh
Next Meter Reading	5/29/2025 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² As a result of previously disclosed circumstances, WG 2 had no energy production February 2024 - June 2024.

³ WG2 was derated to 250 KW for .62hrs on Feb 13 for testing