


A. Site Energy Production Summary*

Energy Production (kWh)					
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	WTG 1	WTG 2	WTG 3
May-24	1,106,000	725,087	270,871	206,159	248,057
Jun-24	836,000	766,124	281,287	214,562	270,275
Jul-24	694,000	444,201	169,239	124,259	150,703
Aug-24	619,000	509,797	191,511	135,123	183,163
Sep-24	839,000	652,549	236,771	178,198	237,580
Oct-24	1,294,000	965,209	362,265	268,971	333,973
Nov-24	1,428,000	1,146,109	404,011	340,300	401,798
Dec-24	1,459,000	1,275,535	426,875	420,969	427,691
Jan-25	1,589,000	1,633,392	585,943	490,527	556,922
Feb-25	1,306,000	790,457	278,380	244,880	267,197
Mar-25	1,331,000	1,736,848	617,707	532,296	586,845
Apr-25	1,335,000	1,077,275	388,957	321,953	366,365
May-25	1,106,000	866,072	300,572	243,799	321,701
Production 2025 (ytd) (kWh)	6,667,000	6,104,044	2,171,559	1,833,455	2,099,030
Total Production (LTM) (kWh)	13,836,000	11,863,568	4,243,518	3,515,837	4,104,213
Capacity Factor (LTM)	30.10%				

B. Site Energy Production Graph

May-2025

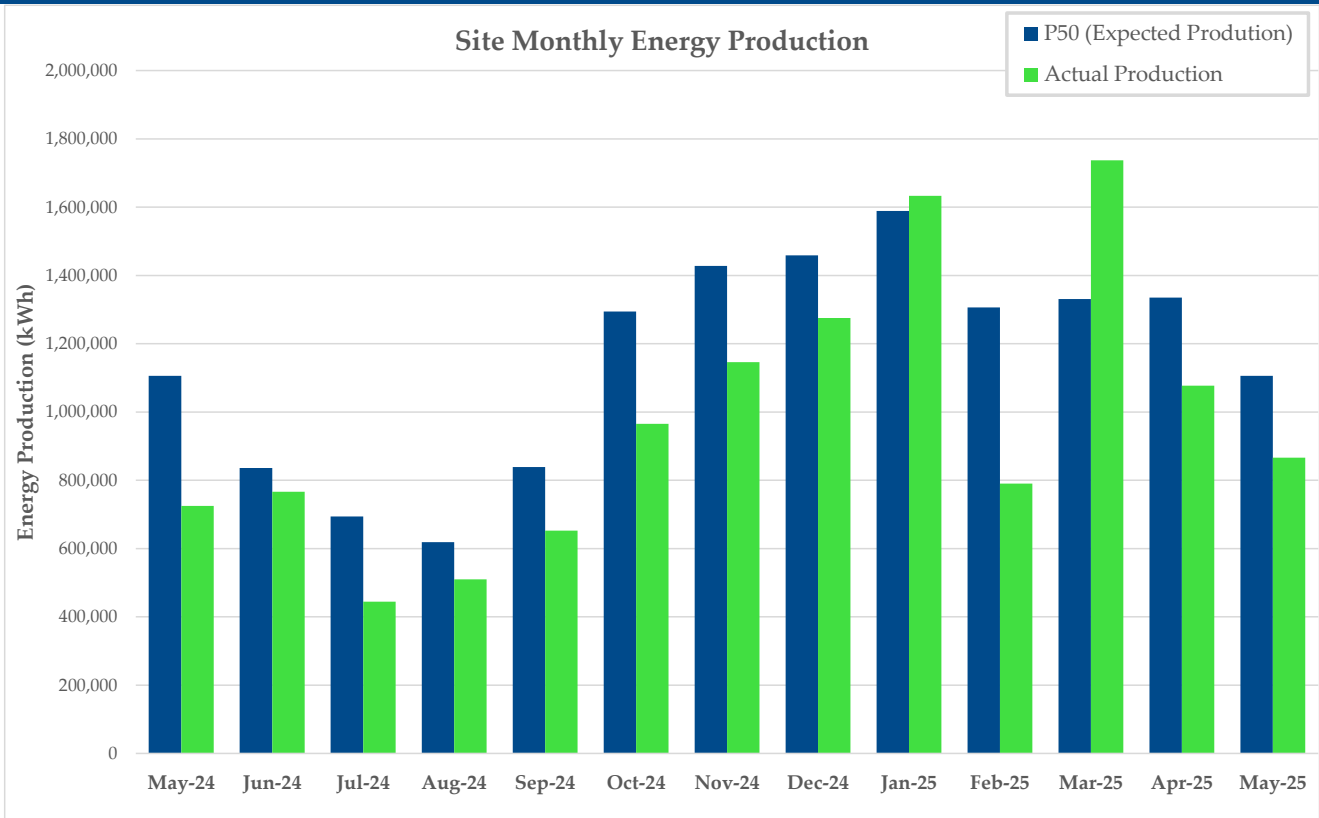

Monthly Report
May-2025

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
Near Miss(es)	0	0

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2025	1 Year Preventive Maintenance	~15	WTG 1
September-2025	1 Year Preventive Maintenance	~15	WTG 2
September-2025	1 Year Preventive Maintenance	~15	WTG 3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
5/28/2025-5/30/2025	Turbine Fault	Unplanned	47.44	WTG 1

F. Turbine Downtime ¹

Downtime (hr)	This Month	Year To Date
WTG 1	52.47	259.82
WTG 2	8.39	195.57
WTG 3	3.57	283.81
Total	64.43	739.20

G. Billed Data

Meter Reading (Date/Time)	6/1/2025 12:00 AM
Meter To Date Produced	13,113,274
Meter To Date Consumed	41,848
Last Reading Produced	12,260,310
Last Reading Consumed	39,399
Billed kWh	850,515 kWh
Next Meter Reading	7/1/2025 12:00 AM

H. Report Notes and Comments

¹ Turbine Availability/Downtime Pending.

² WTG 3 was derated to 1000 kW for 22.28 hrs March 28-March 29

²WTG 3 was derated to 1000 kW for 27.98 hrs April 2-April 3

²WTG 3 was derated to 1000 kW for 43.58 hrs April5-April 7