


A. Site Energy Production Summary

	Energy Production (kWh)				
	Site		By Turbine		
	P50 (Expected Production)	Actual Production	W1	W2	W3
Jun-24	634,000	512,583	178,220	152,008	182,355
Jul-24	527,000	347,033	118,853	106,389	121,791
Aug-24	449,000	293,672	100,620	93,127	99,925
Sep-24	610,000	401,369	130,058	125,317	145,994
Oct-24	990,000	624,977	226,024	151,986	246,967
Nov-24	1,123,000	1,012,898	346,441	326,379	340,078
Dec-24	1,153,000	890,936	306,203	296,619	288,114
Jan-25	1,306,000	1,219,137	428,208	389,061	401,868
Feb-25	1,137,000	646,378	234,980	200,956	210,442
Mar-25	1,134,000	1,354,053	450,894	486,025	417,134
Apr-25	1,176,000	1,009,486	337,030	330,554	341,902
May-25	927,000	704,910	254,853	236,475	213,582
Jun-25	634,000	436,910	136,069	145,251	155,590
Production 2025 (ytd) (kWh)	6,314,000	5,370,874	1,842,034	1,788,322	1,740,518
Total Production (LTM) (kWh)	11,166,000	8,941,759	3,070,233	2,888,139	2,983,387
Capacity Factor (LTM)	22.68%				

B. Site Energy Production Graph

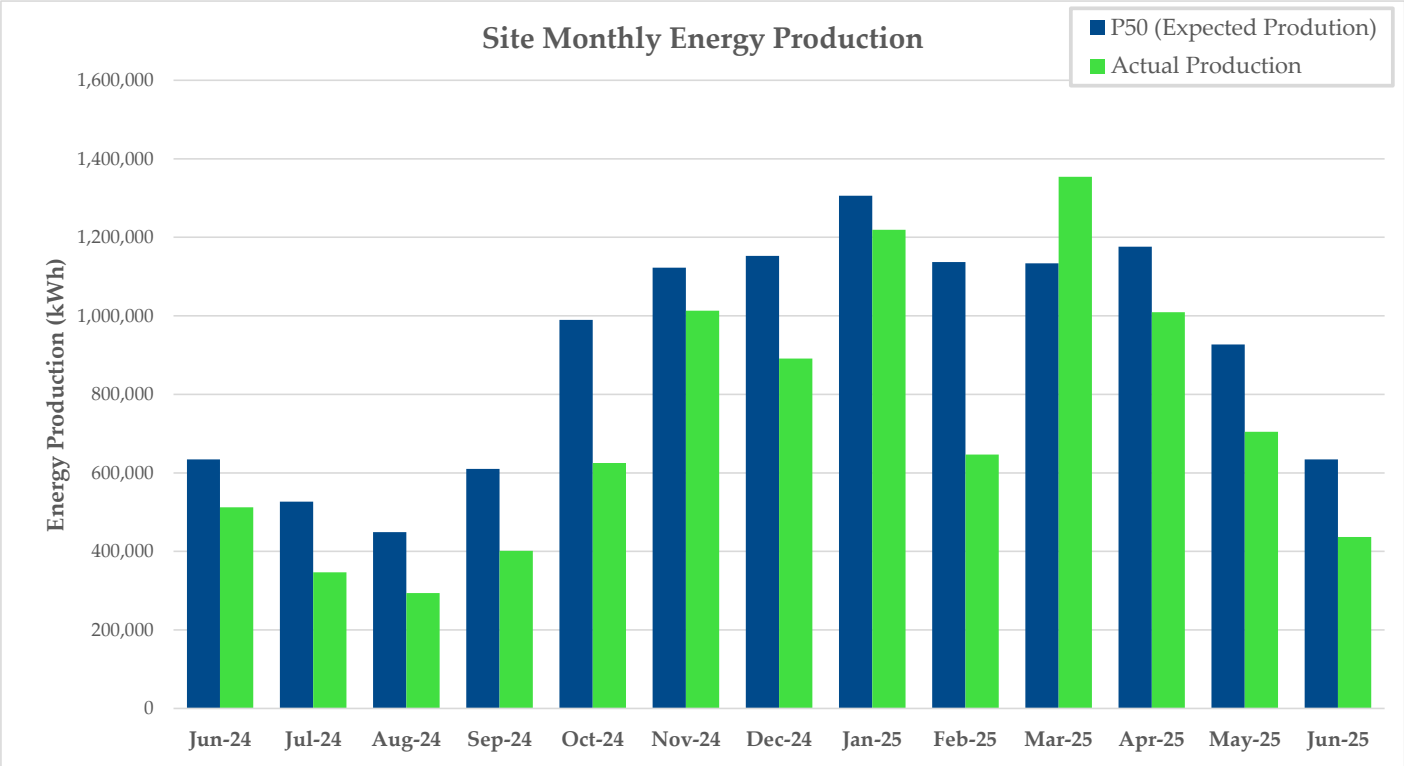

Monthly Report
June-2025

C. Safety Summary

	This Month	Project Cumulative
Recordable Incident(s)	0	0
First Aid	0	1

D. Planned Maintenance Events

Date	Event	Duration (hr)	Turbine
September-2025	7.5 Year Preventive Maintenance	~15	W1
September-2025	7.5 Year Preventive Maintenance	~15	W2
September-2025	7.5 Year Preventive Maintenance	~15	W3

E. Actual Maintenance Events

Date	Event	Planned/Unplanned	Duration (hrs)	Turbine
6/21/2025-6/23/2025	Turbine Fault	Unplanned	34.56	W1

F. Turbine Downtime and Uptime¹

Downtime (hr)	This Month	Year To Date
W1	38.17	189.45
W2	3.61	168.29
W3	3.82	350.58
Total	45.60	708.32

Uptime (hrs)	Life Time
W1, W2, W3	65808.00

G. Billed Data

Meter Reading (Date/Time)	6/21/2025 12:00 AM
Meter To Date Produced	67,153,356 kWh
Meter To Date Consumed	224,394 kWh
Last Reading Produced	66,628,996 kWh
Last Reading Consumed	221,673 kWh
Billed kWh	521,639 kWh
Next Meter Reading	7/21/2025 12:00 AM

H. Report Notes and Comments

¹Turbine Downtime and Uptime Pending

²W1 derated to 1000 kW for 142.2 hrs from October 2024 - February 2025

²W2 derated to 1000 kW for 48.01 hrs in October 2024

²W2 derated to 800 kW for 21.6 hrs in October 2024

²W3 derated to 1000 kW for 25 hrs in November 2024

²W1 derated to 1000 kW for 178.92 hrs in March 2025

²W1 derated to 1100 kW for 2.67 hrs on March 31

²W1 derated to 1200 kW for 1.28 hrs on March 31

²W1 derated to 1300 kW for 1.1 hrs on March 31

²W1 derated to 1100 kW for 1.13 hrs on April 2

²W1 derated to 1200 kW for 29.03 hrs from April 2 - April 3

²W3 derated to 1000 kW for 17.12 hrs from May 1-May 2